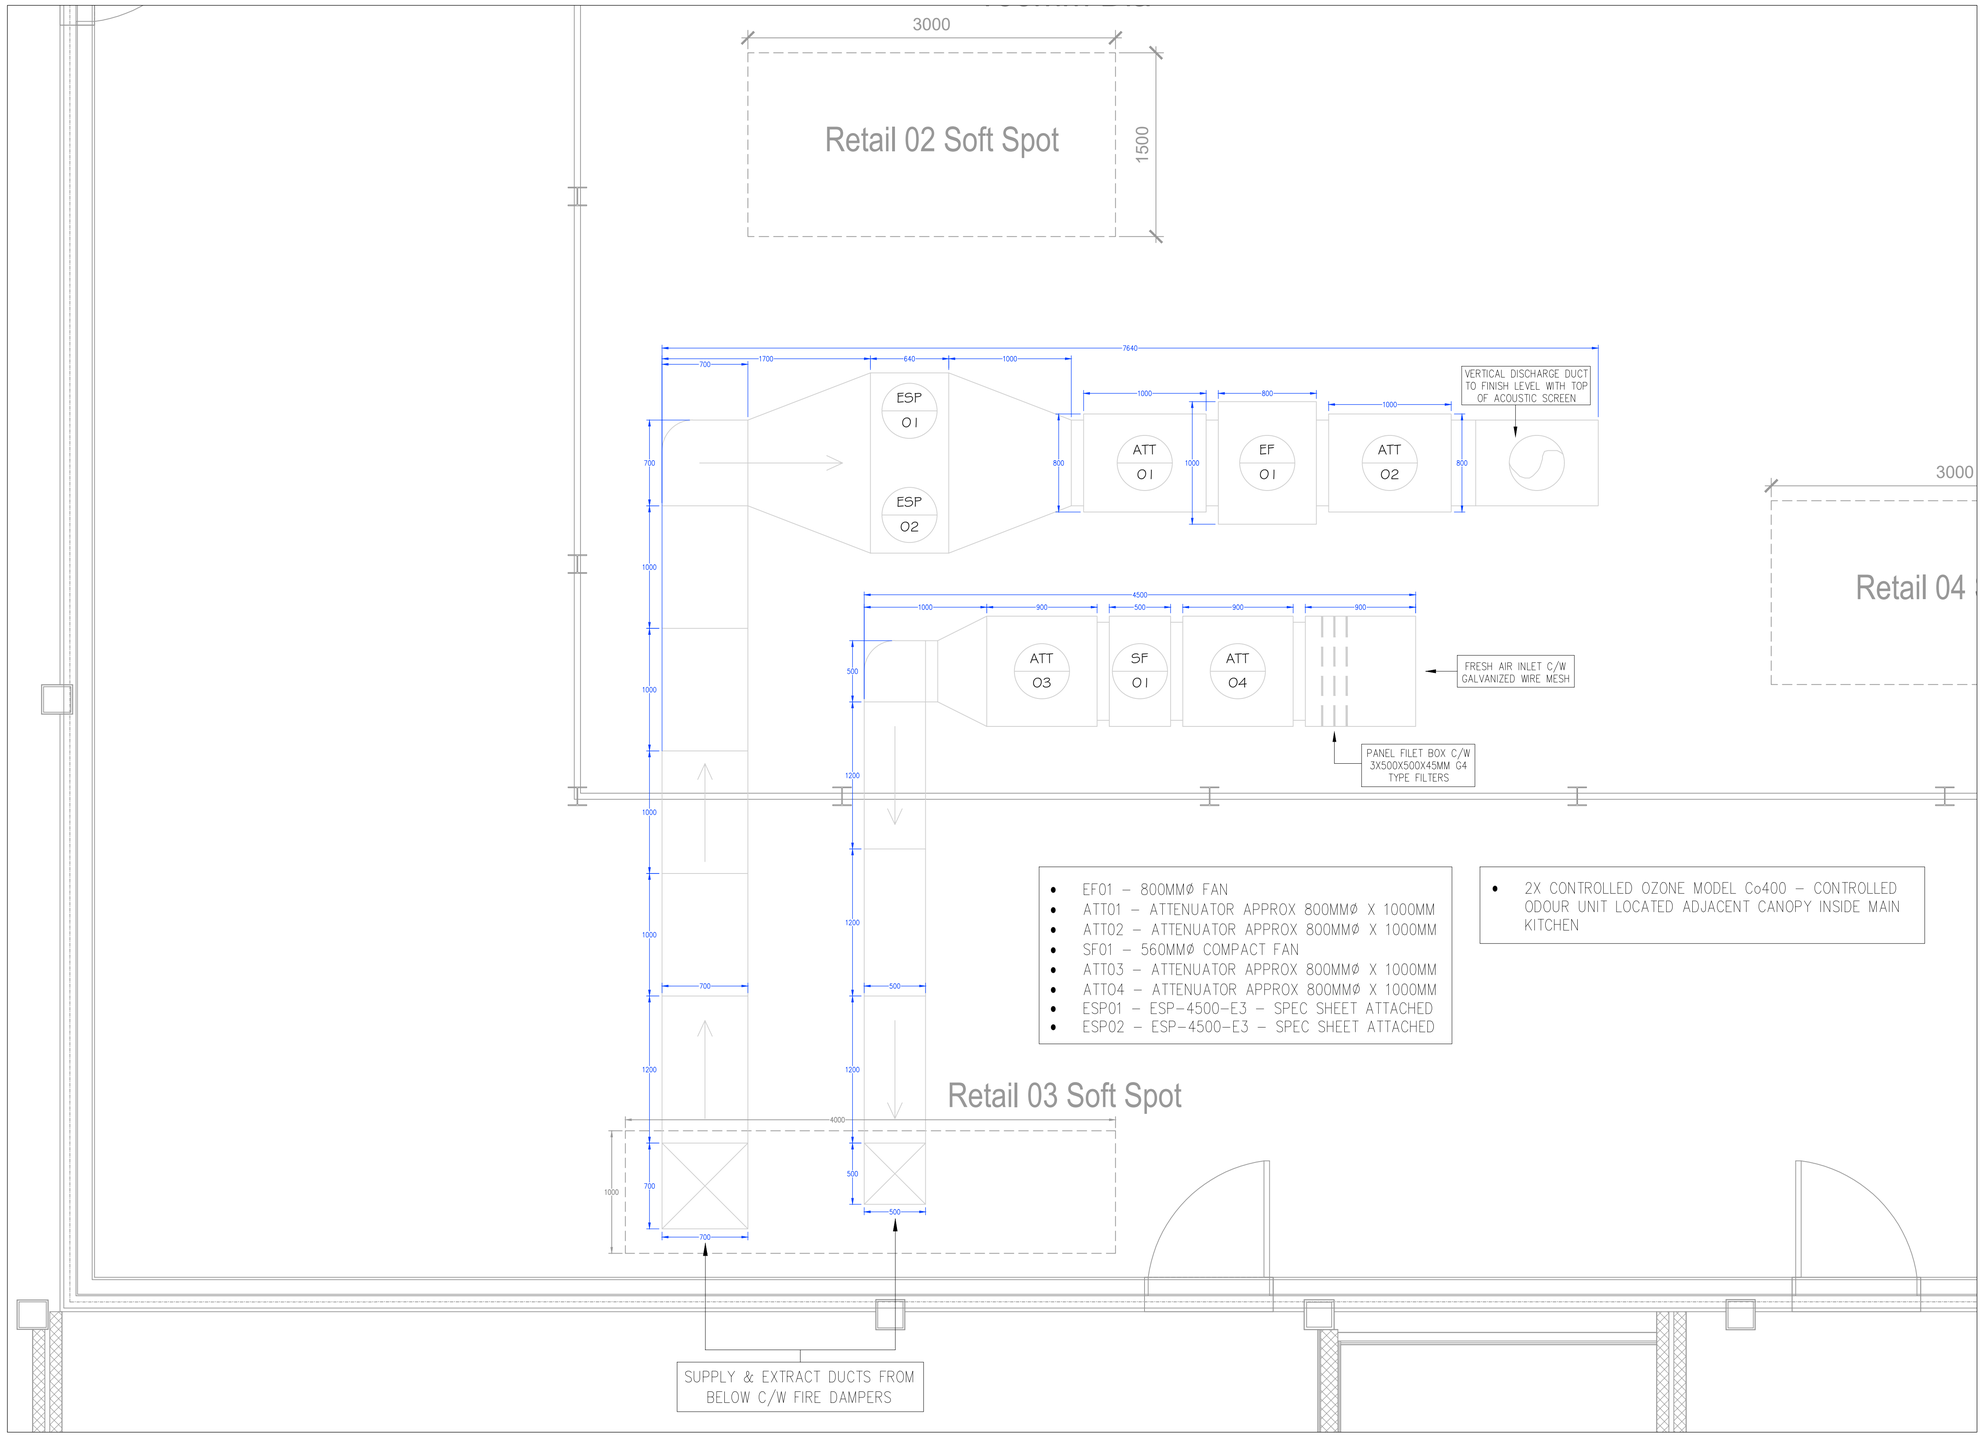

- EF01 – 800MMØ FAN
- ATT01 – ATTENUATOR APPROX 800MMØ X 1000MM
- ATT02 – ATTENUATOR APPROX 800MMØ X 1000MM
- SF01 – 560MMØ COMPACT FAN
- ATT03 – ATTENUATOR APPROX 800MMØ X 1000MM
- ATT04 – ATTENUATOR APPROX 800MMØ X 1000MM
- ESP01 – ESP-4500-E3 – SPEC SHEET ATTACHED
- ESP02 – ESP-4500-E3 – SPEC SHEET ATTACHED

- 2X CONTROLLED OZONE MODEL Co400 – CONTROLLED ODOUR UNIT LOCATED ADJACENT CANOPY INSIDE MAIN KITCHEN

REV	PURPOSE OF ISSUE	ENG. RELEVANT DWG. No.	DRAWN	DATE

REV	MODIFICATION NOTES	DRAWN	DATE

Gastronorth
Foodservice Equipment

GastroNorth Ltd.
1st Floor, Merlin House, Princes Park, Princes Way, Team Valley Trading Estate,
Gateshead, Tyne & Wear, NE11 0NF

© PROTECTED BY COPYRIGHT LAW

ceda
Connecting Our Industry

T: 0191 414 2882 | E: gastronorth@upnorthgroup.com | W: www.gastronorth.co.uk

Proposed External Kitchen Ventilation System

CLIENT / PROJECT	TITLE						
Danielli Leisure Muddler, Sunderland	Proposed External Kitchen Ventilation System						
	SCALE @A1	DRAWING NUMBER		REVISION	DRAWN	DATE	
	1/25	523	1127	1	0	JB	20/02/24