

NOTE

Main contractor to provide a pre-construction information and health and safety file to help them comply with their duties, such as ensuring a construction phase plan PDF is prepared.

Main contractor to reduce or remove any foreseeable health and safety risks to anyone affected by the project (if possible) and to take steps to reduce or control any risks that cannot be eliminated.

PLEASE NOTE THAT BELMONT DESIGN SERVICES HAS BEEN APPOINTED TO DEAL WITH THE INITIAL DESIGN STAGE AND IS NOT INVOLVED IN THE PRE-CONSTRUCTION PHASE

A STRUCTURAL SURVEY OF THE EXISTING BUILDING MUST BE CARRIED OUT PRIOR TO WORK COMMENCING.

ANY REFERENCES TO STRUCTURAL ASPECTS ARE FOR COSTING PURPOSES ONLY. THESE DRAWINGS AND OTHER RELATED DOCUMENTS MUST BE READ IN CONJUNCTION WITH STRUCTURAL ENGINEER'S DRAWINGS, DETAILS AND CALCULATION SHEETS.

THE REMOVAL OF THE WALL WOULD CONSTITUTE A MAJOR RISK AND THE BUILDING CONTRACTOR SHOULD SUBMIT A METHOD STATEMENT TO BE APPROVED BY THE BUILDING INSPECTOR.

All existing walls, foundations and lintels or other structural items are to be confirmed load bearing and adequate for increased loading where relevant prior to work commencing.

SERVICES, etc

NOTE

MAIN CONTRACTOR TO MAKE ALL NECESSARY SEARCHES AND INVESTIGATIONS TO ASCERTAIN THE EXACT POSITION OF ALL UNDERGROUND SERVICES AND UTILITIES PRIOR TO WORK COMMENCING. ANY SERVICES SHOWN ARE INDICATIVE AND TO BE CONFIRMED ON SITE.

All existing relevant meters, external mains gas and water supply pipes, mains drainage pipes, mains electric cables, underground and overhead telephone wires, security systems, aerials, satellite dishes and boilers etc to be re-sited or re-routed prior to work being carried out.

All existing relevant internal gas pipes, power and lighting cables, water storage tanks, hot water cylinders and associated water supply pipe work, telephone wires and communications cables, security systems, heating systems and associated cable or pipe runs to be re-sited or re-routed prior to work being carried out.

PARTY WALL ACT

As part of the works is adjacent to the boundary, the adjacent neighbours right to support could be affected, the issues associated with Party Wall Act may need to be considered. This may include providing information to the adjoining owner, giving sufficient notice of works in compliance with the Act.

FOUL DRAINAGE

New 100mm diameter proprietary polypropylene pipes and fittings to BS 4660:2000 and BS EN1401-1) kitemarked with flexible joints, at minimum gradient of 1:40 run to have class N bedding as specified in Approved Document H1, and minimum 700mm below ground level and to link to existing assumed run at new inspection chamber to BS5301 1985 to be screwed down and comply with Tables 11 of Part H of the Building Regulations. Manhole to local Authority specification.

Where pipe passes through walls, install 150mm deep Naylor pre-cast concrete lintels (with concrete filled to end to protect reinforcement) to give 50mm space all round and sides to be masked with rigid sheet material, and to be protected to Building Controls Approval.

All drainage to conform to BS 8301:1985 " code of practice for building drainage "

FOUNDATIONS

650 x 200mm concrete strip to be doweled to existing to firm bearing at depth of existing, minimum 900mm below finished ground level and at sufficient depth to prevent over sailing of existing pipe runs, existing foundations, existing foundations to basement walls, or basement walls to adjacent dwellings. Trenches to be braced during ground works when foundations are deeper than 1200mm to prevent collapse.

* NOTE: - Foundation sizes have been taken from Approved Document A1/2, table E1, and allow for 50KN / m. Run on firm clay. This must be confirmed by the main contractor, and to be to the satisfaction of the Building Inspector.

NOTE: - Firm clay must be confirmed by the main contractor, and to be to the satisfaction of the Building Inspector, prior to work commencing to ensure that the contract is not delayed.

Class A foundation blocks to be used below ground level, and positioned centrally on footings.

Existing foundations to be uncovered prior to work commencing, to ensure the structural integrity for increased loading, and to be to the satisfaction of the Building Inspector.

GROUND FLOOR

150mm concrete slab with 1 layer of A193 mesh with 40mm top cover with flexible filler to perimeter, on 100mm Kingspan Thermalfloor TF70 Floor turned up at slab perimeter, on 2000 grade damp proof membrane, on minimum 25mm sand blinding, on min 150mm well consolidated sulphate-free hardcore to suit conditions.

Floor to attain a maximum of 0.18 w/sq.m/deg.k.

Damp proof membrane to be lapped over any existing damp proof course and over proposed damp proof course in external wall.

WALLS

Comprised of 102mm brick to match existing, 150mm overall cavity - 50mm clear cavity with 100mm Kingspan KOOLTHERM K118 partial cavity fill slab insulation fitted to manufacturers details with 100mm high strength 7kn Celcon block inner leaf and instructions with 12.5mm plaster and skim finish.

Wall construction to attain a maximum of 0.16q.m/deg.k.

All joints between skirting and walls and floors to be air sealed with sealant. All plasterboards when been fixed to wall are to be sealed from corner to corner (not dob and dab) All pipes, wires and services going through walls and ceiling are to be sealed with sealant. All windows and external doors are to be air sealed.

Movement joints at maximum 6000c/c (check with manufacturer) with proprietary movement joints ties to every course to manufacturers details

Existing cavities broken out and keyed into existing, maintaining continuous clear cavity.

Stainless steel double triangle wall ties to suit at 750mm c/c horizontally and 450mm c/c vertically, staggered and at 225mm c/c within 300mm centres around openings.

Cavities to be clear of all debris, filled to ground level with weak mix mortar trowelled to channel water to exterior, and cavities closed using mineral wool in a polythene cover at windows, doors and eaves. Weepholes at maximum 900mm c/c.

Damp proof course to be installed minimum 150mm above finished ground level and stepped where necessary.

215 x 140mm airgrates maximum 1800mm c/c and linked to existing with ducting. Cavity trays to be installed directly over airgrates.

Code 4 lead flashing to all abutments minimum 150mm upstand chased into existing external wall minimum 25mm. Install cavity trays to abutments directly above flashing stepped along roof pitch, weepholes at maximum 900mm.

Universal steel beams to structural engineer's specification bolted together and clad in 2 layers 12.5mm Gyproc fireline board to give 30 minutes fire resistance.

INTERNAL MASONRY PARTITIONS

Wall between garage and main house to be 100mm Celcon Standard blocks with Kingspan insulated plasterboard (80mm insulation and 12.5mm plasterboard and skim finish) fixed to 25mm x 50mm timber battens or dot/dab as required.

INTERNAL TIMBER PARTITIONS

Comprised of 75 x 75mm sw C16 head and sole plates, 75 x 50mm studs at 400mm c/c, 75 x 50mm noggins at 900mm c/c, staggered 450mm in alternate bays, with 12.5mm plasterboard (moisture resistant to wet areas) and skim to each side, and the whole infilled with insulative quilt.

Joists to be doubled along partitions running parallel to such.

WINDOWS

NOTE

Ground floor windows should be secure to a design set out in Paragraph 2.2 and 2.3 of Part Q of the Building Regulations and should be made to a design that has shown by tests to meet the security requirements of British Standards Publications PAS 24:2012.

Windows should be mechanically fixed to the structure of the building in accordance with the manufacturers installation instructions.

Reasonable provision must be made to resist unauthorised access to a dwelling to show compliance with Regulation 4, Schedule 1, Part Q Security Dwellings, laminated glazing to accessible ground floor windows

Velux rooflight to be inserted to roof as indicated. Rafter and ceiling joists to be doubled up both sides.

Opening lights to be minimum 1/20th floor area.

Masons openings to have all necessary horizontal dpes, vertical dpes and cavity trays. Toughened glass to all windows below 800mm above finished floor level, and to all doors below 1500mm above finished floor level and all adjacent windows, and windows and all external doors to be double-glazed sealed upvc units with a 20mm sealed (low E emissivity = 0.05, argon filled), style to match existing and adjacent, with thermal breaks to frames, and draught excluders, with 10,000mm2 trickle vents to each habitable room or 10,000mm2 for single storey dwellings. (Part F Table 1.7)

Open plan kitchen diners need a minimum of 3 trickle vents in a room (8000mm2 each) (Part F, Paragraph 1.52)

PURGE VENTILATION

All habitable windows should have an opening window.

Energy efficiency measures in existing house to be assessed by building control. Ventilation of existing dwellings will be assessed. Undertaking multiple minor works (insulating lofts, replacing loft hatches etc) or major works (including bricking up chimneys, installing internal walls insulation etc) in most cases retrofitting trickle vents will be an adequate measure. (Table 3.1 part 3.6-3.13).

Lintels to be catnic (or similar approved), installed in accordance with manufacture's specification, and sized as shown on drawings. Weepholes over lintels to be 450mm c/c.

All architraves and skirting to match existing and adjacent.

Windows to attain a maximum of 1.4 w/sq.m/deg.k.

Doors to attain a maximum of 1.4 w/sq.m/deg.k.

DOORS

External doors to have draught excluders and weather bars.

DESIGN OF SECURE DOORSETS

Door and lock to a design that has been shown by tests to meet security requirements of British Standards Publications PAS 24:2012 or designed and manufactured in accordance with Appendix B

Doors should be mechanically fixed to the structure of the building in accordance with the manufacturers installation instructions.

INTERNAL DOORS

Door type and accessories to clients approval. 10mm ventilation gap to be provided under all new internal doors to provide the required ventilation under Part F of the Building Regulations 2010

CEILING

100mm x 50 mm sw C16 ceiling joists at 400mm c/c, with 12.5mm plasterboard and skim to underside. Joists secured to external wall with 5 x 30mm galvanized mild steel straps at maximum 1500mm c/c along joists perpendicular to the wall, and maximum 900mm along joists parallel to the wall.

Roof to attain a maximum of 0.15 w/sp.m/deg.k.

CEILING

200mm x 50 mm sw C16 ceiling joists at 400mm c/c, with 150mm Rockwool quilt insulation between and 150mm insulation laid above to utility and study and 12.5mm plasterboard and skim to underside and skim finish to underside. Joists secured to external wall with 5 x 30mm galvanized mild steel straps at maximum 1500mm c/c along joists perpendicular to the wall, and maximum 900mm along joists parallel to the wall.

Roof to attain a maximum of 0.15 w/sp.m/deg.k.

FLAT ROOF

Constructed from GRP system or single ply membrane system by specialist on membrane/boarding as required, and strictly in accordance with BS 747 and "Flat Roofing: a guide to good practice", taken 450mm under existing main body slates, on 19mm external grade wbp plywood to 1:60 falls (achieved by diminishing firings minimum 25mm on each joist) on 50mm square counter battens at 450mm c/c, giving a minimum of 50mm ventilation to roof, on sw C16 flat roof joists to engineers details with 12.5mm plasterboard, with Vapour barrier between plasterboard and timber, and skim to ceiling, with 100mm polyurethane insulation laid between joists and a further 50mm polyurethane insulation fixed across the face to give a total insulation thickness of 1400mm with 50mm air gap. All verges and other internal angles of roofing felt to be turned using 50mm fillets, and to be lapped into gutter at eaves. Minimum 150mm upstand of roofing felt at all masonry junctions, with proprietary ventilation strip at abutment to existing house wall. Holding down ties to perimeters to be 25mm x 3mm galvanized steel straps at 1500mm c/c.

Achieves 0.15w/sq.m/deg.k

All external timber to be tanalised or preservative treated.

GENERAL NOTES

Cavity wall and ground floor insulation to be continuous

PITCHED ROOF

Double Roman interlocking concrete roof tiles to garage colour to match existing main body roof on 38 x 50mm sw battens, on breathable roofing underlay to BS 5534 installed strictly as manufacturers instructions. on 200mm x 50mm sw SC3 rafters at 400mm c/c, supported at upper end by 75 x 150mm sw C16 pisle fixed to existing external wall with 12mm rawl bolts at 500mm c/c, and at lower end by 125mm x 100mm wall plate to perimeter, fastened with 5 x 30mm galvanized mild steel holding down straps at maximum 900mm c/c, and rafters fastened to gables with 5 x 30mm galvanized mild steel lateral restraint straps at 900mm c/c.

Eaves comprising pvcu fascia, and pvcu soffit, 25mm proprietary continuous insect-proof ventilation strip to underside, and ventilation trays to rafters to ensure continuous ventilation over insulation.

Install proprietary ventilation strip to abutments of main body house and monopitch roof.

Install 100mm Kingspan K7 inbetween rafters leaving a minimum 50mm air gap with 62mm K18 rigid insulation and plasterboard fastened to underside of rafters, and skim to underside. Achieves 0.15w/sq.m/deg.k

All external timber to be tanalised or preservative treated

RAINWATER

New 115mm gutter to match existing and 75mm diameter down pipes to have roddable back inlet yard gullies installed at base.

SANITARY PIPEWORK

New 40mm diameter upvc wastepipes, maximum 3.0m run to soil pipe, from sinks and shower to have minimum 75mm deep seal and fitted with anti-vacuum traps. New 100mm diameter upvc soil-pipe from wc to have minimum 50mm deep seal and linked to existing run.

Hot water supply to bath to be limited to 48 degrees c, suitable temperature control device to be fitted

All pvcu pipe work to BS 4514, and tested for water tightness to BS 5572: 1978 "code for practice for sanitary pipe work ". New soil pipe to have rodding eye installed at base and encased in timber duct and clad in plasterboard with removable access panel.

Vent pipes terminated at a height of minimum 900mm above any opening into the building within 3.0m and to be fitted with a bird-proof cage to head.

VENTILATION

Kitchen room to have 60 litres/second extract fan. (30 litres/second if adjacent to hob)

Utility and shower room to have 30 litres/second extract fan

LIGHTING

100% of light fittings to be capable of taking a low energy light bulb.

Lighting to have an average initial (100 hour) lamp plus ballast efficiency of not less than 50 lamp-lumens per circuit watt. Switches to be located in suitable positions for light efficiency.

HEATING


Radiators to be provided and connected to existing boiler, (boiler to be confirmed adequate and energy efficient to Building Controls approval). Thermostatic valves to all new radiators and all pipes to be insulated in unheated spaces.

Commissioning certificates to be provided to building control.

ELECTRICS

Switches and plugs to be provided, number and position to clients approval. Height of the plugs and switches to be between 450mm and 1200mm. All electrical work required to meet the requirements of part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so, and certificate to be provided on completion.

All wiring to Part P BS 7671 (electrical safety) must be designed, installed, inspected and tested by a person competent to do so.

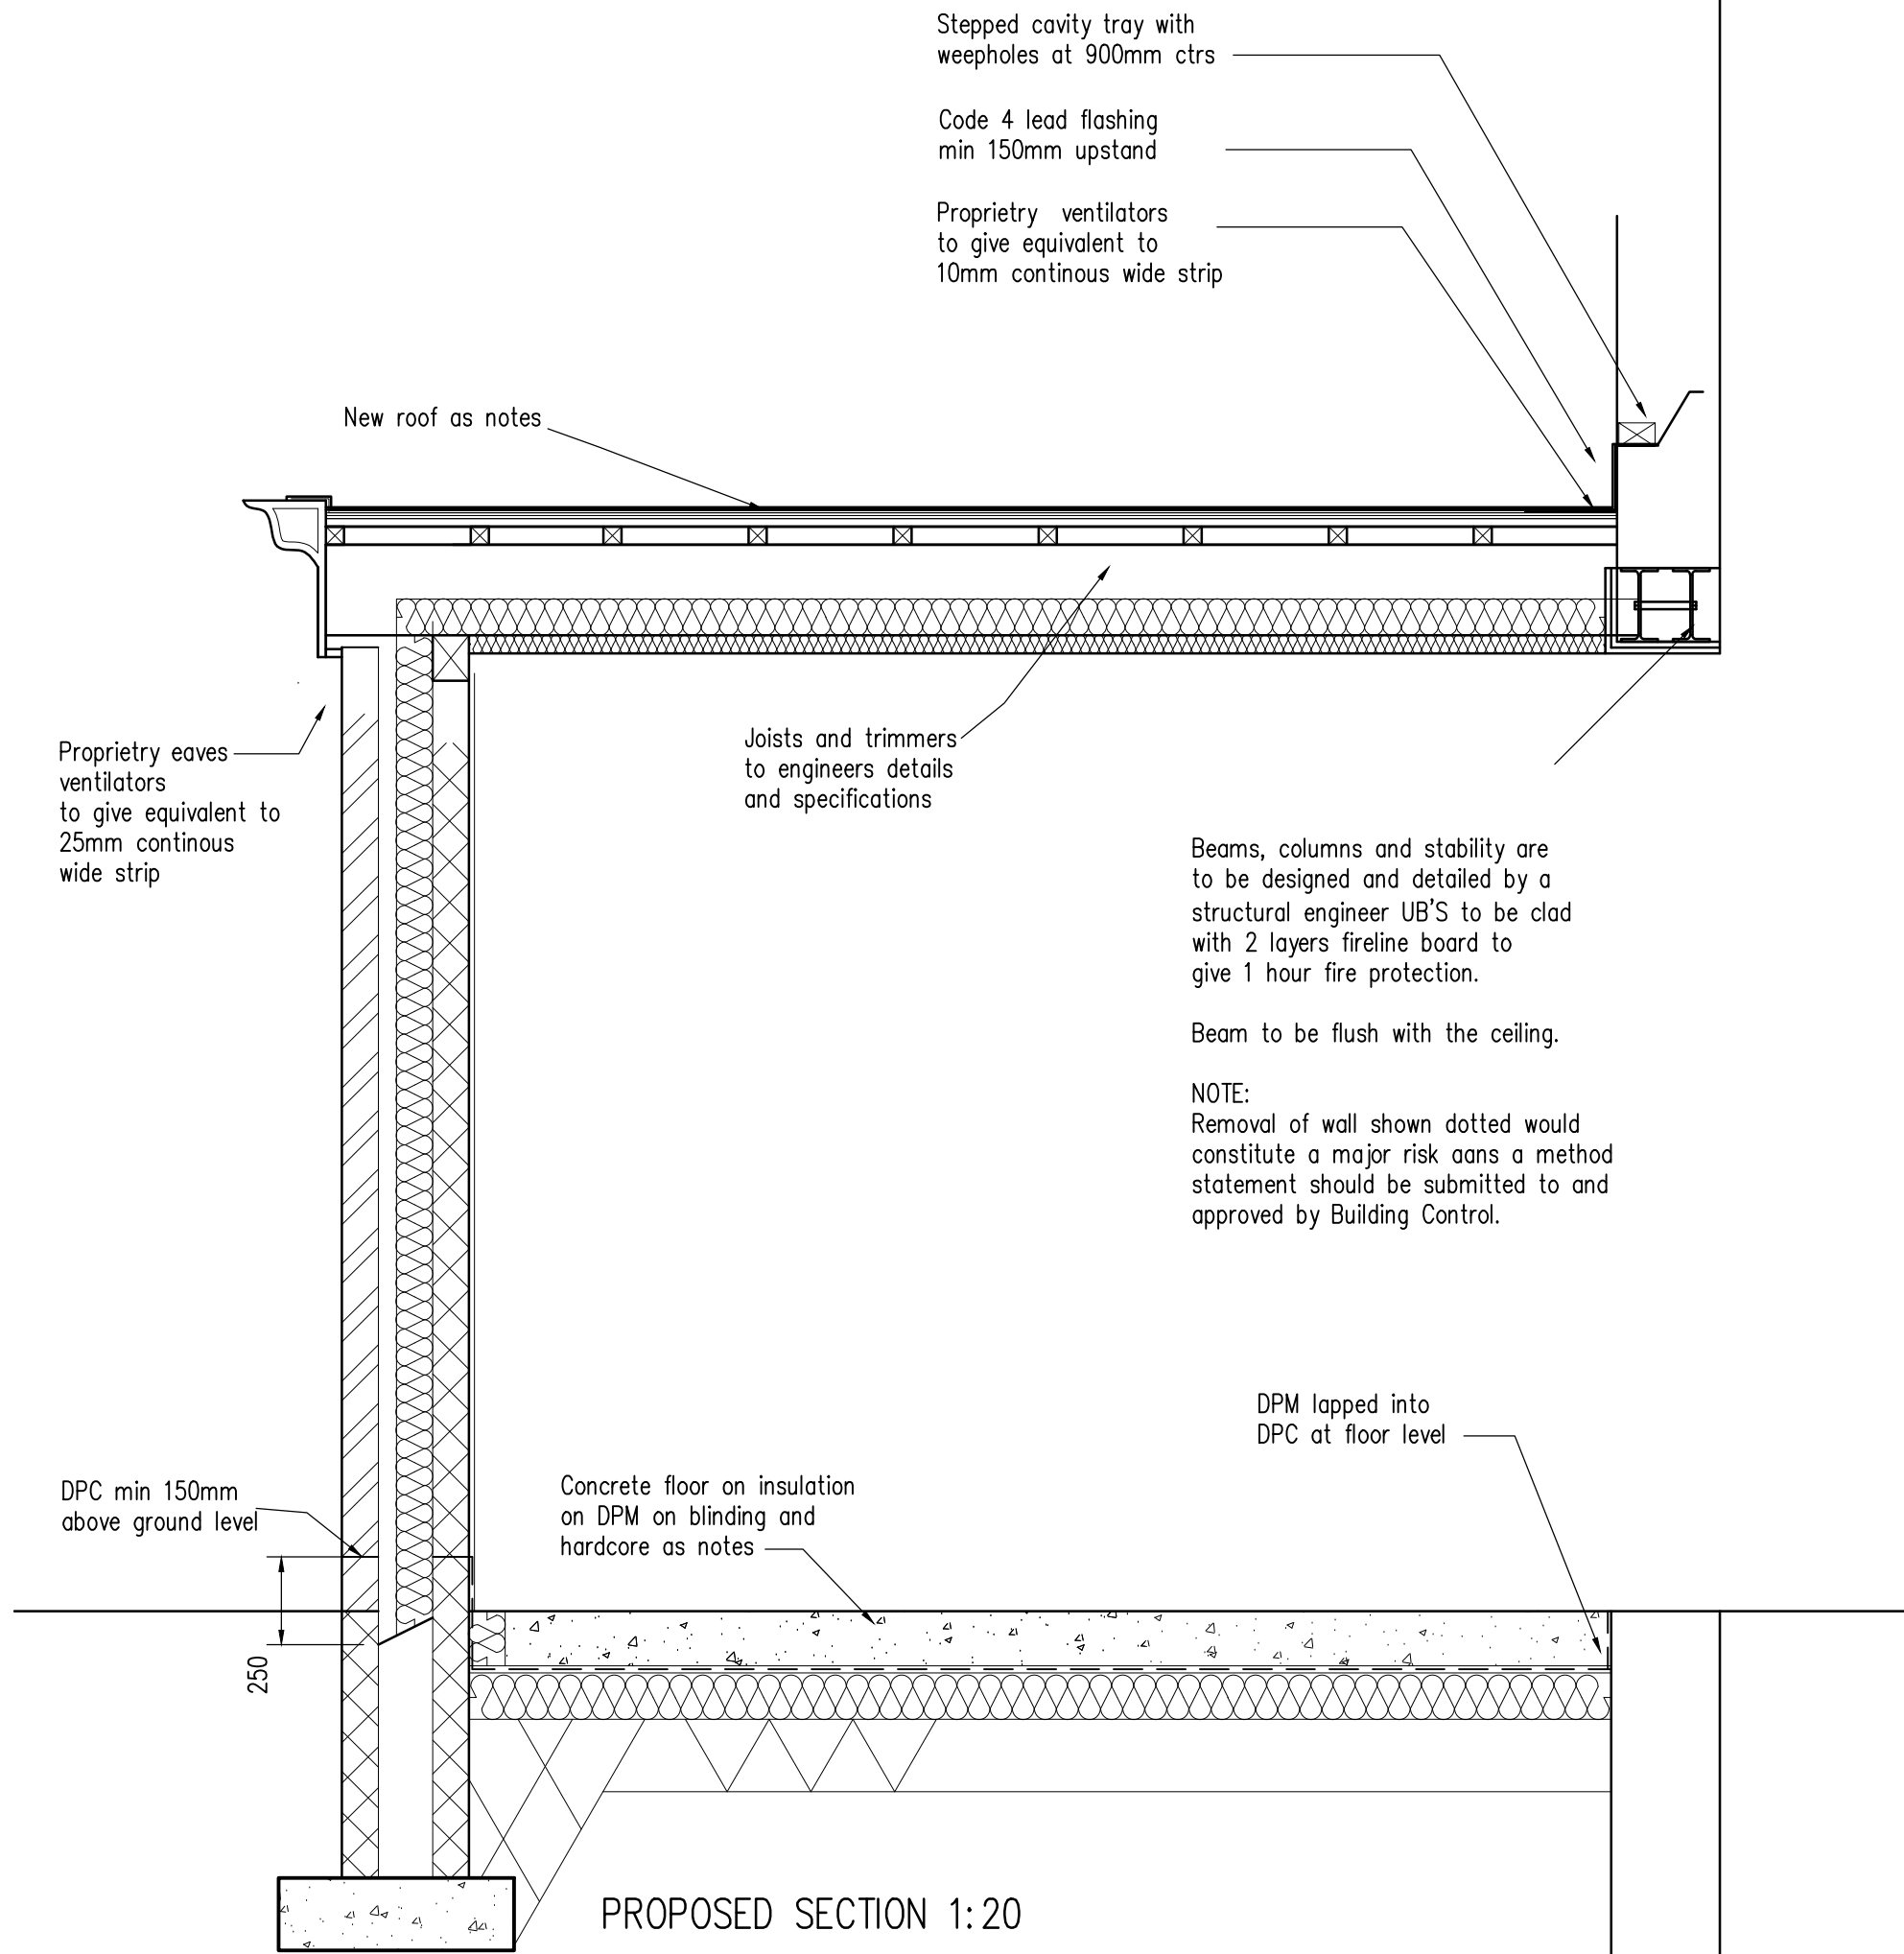

This drawing and its contents are the copyright of Belmont Design and must not be used, reproduced or amended without prior consent from such.

This drawing is not a working drawing, and is only for the purpose of the following :-

- A - Planning Submission
- B - Building Regulations Submission

The main contractor is responsible for informing Belmont Design of any discrepancy on, or between, this drawing and any other related document.

All existing walls, foundations and lintels or other structural items are to be confirmed load bearing and adequate for increased loading where relevant prior to work commencing.

Any existing walls to be removed are to be confirmed non-loadbearing prior to removal.

Boundaries, angles, and dimensions are to be checked by the main contractor prior to work commencing.

Written dimensions only to be used from this drawing. - if doubt exists consult Belmont Design for clarification.

NOTE

Client please note that you have duties under the CDM 2015

Main contractor to provide a pre-construction information and health and safety file to help them comply with their duties, such as ensuring a construction phase plan PDF is prepared.

Main contractor to reduce or remove any foreseeable health and safety risks to anyone affected by the project (if possible) and to take steps to reduce or control any risks that cannot be eliminated

CDM Contractor is to ensure stability of existing structure throughout the works

Contractor to note heavy elements, specifically steel beams.

PLEASE NOTE THAT BELMONT DESIGN SERVICES HAS BEEN APPOINTED TO DEAL WITH THE INITIAL DESIGN STAGE AND IS NOT INVOLVED IN THE PRECONSTRUCTION PHASE



ARCHITECTURAL SERVICES
231 High Street Wibsey, Bradford. BD6 1QR
www.belmontdesign.co.uk

PROPOSED SINGLE STOREY TO SIDE AND REAR AT :
1 WATERING MEADOW MORLEY LEEDS LS27 8BF

FOR : MISS HILL AND MR A CLARIDGE

Section and Specification
Date - January 2024
Scale - 1:20
Dwg No. - 10067/04