

SPECIFICATION

Preparing for topsoil
Grading and cultivation shall be in accordance with BS 4428:1989 section 4.
Subsoil that is to receive topsoil shall, whether already incorporated or not, be thoroughly broken up by hand, by heavy rollers, by subsoiler or fixed equipment with adequate passes made to thoroughly break up the surface to a depth of 100mm, cleared of all large stones, boulders, perennial weeds, tree roots (excluding living tree roots), coarse vegetation and other extraneous matter.

Subsoil grading
Subsoil shall only be graded after loosening as above, and this shall be undertaken by the use of a tractor and blade grader on large areas and by a small mechanical grader or by hand on small areas. BS 4428 shall be followed by the use of heavy machinery, for grading or any other purpose after subsoiling and/or topsoiling has taken place.

Making up levels
Where subsoil is deposited in low lying areas to raise formation levels, it shall be lightly compacted and left broken on ready to receive topsoil. Imported BS 1582 material shall be retained against free from metals, concrete or organic material with any one dimension greater than 100mm. All imported fill material shall be approved by the Landscape Architect prior to spreading on site.

Supply of topsoil
Topsoil to be supplied shall be approved by the Landscape Architect and details of the source of supply shall be provided to the contractor that inspection may be made before delivery commences. Topsoil shall conform to BS 3882: 2015. Recommendations and classification for topsoil, clause 4.1. The soil shall be free of weeds, roots or perennial weeds, pests, diseases, debris, tree roots, stumps, subsoil and foreign matter and shall be capable of being broken down to a fine tilth.

Temporary topsoil heaps
The depositing of temporary heaps of topsoil shall be so arranged that possible damage to existing plants, lawns, pavings etc. is avoided. Unless otherwise agreed by the Landscape Architect, temporary soil heaps shall be on the proposed ground. Such protection shall be in the form of plastic sheets, boards or similar covering. If damage does occur, it shall be made good at the contractor's own expense. Areas excavated to receive topsoil but have not had the base loosened shall not be used as temporary loading areas. If the bottom of the excavation has been loosened off, loading on these areas is permissible.

Spreading topsoil
Prior to topsoil replacement the formation level shall be cleared of all stones, rubbish, debris with any one dimension greater than 75mm. Areas to be seeded or sowed shall be covered to the topsoil 100mm thick and areas to be planted shall be covered by topsoil 400mm thick. Topsoil shall be spread in an evenly consolidated layer and shall be left clear of all rocks, stones and debris with any one dimension greater than 50mm throughout its depth. Unless otherwise stated the finished level shall be 25mm above adjacent hard top. Topsoil shall be spread until the subsoil grade has been inspected by a Landscape Architect.

PLANTING
Cultivation
Planting areas shall be reworked to a depth of 225mm in the original ground, or where the ground is compacted, opened and reworked. Pick off stones, bricks, timber and all other debris arising which have any dimensions greater than 50mm and remove to site tip. Do not cultivate across any drain where the stone is flush with the ground surface.

Soil Improvers
Where directed composts, fertilisers or other additives shall be incorporated into the soil. Speed mushroom compost or similar shall be spread by the specified thickness and incorporated, by rotovating, into the top 150mm. Fertilisers, organic or inorganic, shall be sowed into the top 25mm.

Rejection of plants
All plant material should comply with the minimum requirements in BS 3938-1: 1992 Specification for trees and shrubs and BS 3938-2: 2007 Specification for trees. Any plant material, which in the opinion of the Landscape Architect, does not meet the requirements of the Specification, is unsuitable, or defective in any other way, will be rejected. The minimum specified sizes in the plant schedule will be strictly enforced. The contractor shall replace all plants rejected at his own cost.

Planting
All plant material shall generally be planted between November and March in open cool weather. Planting shall not take place in frosty, snow or waterlogged conditions. Where approved, pot or container grown plants may be planted outside the specified season. All plants shall be inspected by the contractor and damaged roots and branches shall be clearly pruned prior to planting.

Planting of white, transplants and shrubs
The nature of the material to be planted is variable and the contractor shall advise for planting to be properly carried out in all cases as specified in BS 4428: 1989 section 7 Annexe tree planting, section 8 Woodland planting and section 9 Planting of shrubs, herbaceous and bulbs. All plants shall be planted at same depth, or very slightly deeper, as they were grown. Roots shall not be bent, broken or forced into awkward positions or notches. Plants shall be firm in and wind resistant, with no air pockets around roots. All pots and root wrappings shall be carefully removed prior to planting. All pots and root wrappings immediately be picked up and stored ready for removal to tip. Plants shall be planted at the specified centres. On steep slopes this shall be in the horizontal measure.

Tree planting within soft landscape areas
Trees shall conform to BS 3938-1: 1992 and be planted in tree pits of the following sizes:
Feathered trees - 900 x 900 x 400
Selected standards - 1000 x 1000 x 400
Heavy standards/Extra heavy standards - 1200 x 1200 x 600
Expanded subsoil or stone shall be carried off to the bottom 250mm of the pit shall be dug and broken up. The bottom of the pit shall be backfilled with the soil (see BS 3882: 2015). The top 300mm of the pit shall be backfilled with imported topsoil as specified unless directed otherwise.

Compost for planting pits
Compost shall be a proprietary product, bark based incorporating fertilisers and improving additives. The type of compost shall be approved before delivery on site, and the details of the product shall be supplied. Compost planting pits are approved. Where directed compost shall be added to and mixed with topsoil backfill at the following rates:
Feathered trees - 40 litres
Selected standards - 60 litres
Heavy standards/Extra heavy standards - 80 litres

Stakes for trees
Stakes shall be peeled round softwood, pointed, minimum diameter 75mm. The stakes shall be driven into the base of the tree pit prior to placing the tree and backfilling.
Stakes shall in general have a clear height above the finished ground level as follows unless directed otherwise:
Feathered trees - 750mm (one tie)
Selected standards - 900mm (2 stakes, one tie each)
Heavy standards/Extra heavy standards - 1200mm (2 stakes, one tie each)
The stake shall be long enough to drive until they hold the tree firmly without rocking.

Tree ties
Ties for bare-root trees, shall be approved rubber nail-on type with cushioned spacer such as Toms, or other equal and approved. Nails shall be lead headed galvanised and shall hold the ties securely into the stake. Ties shall not be over tight on the tree stems. Ties available from Toms Limited, Wheeler Street, Headcorn, Ashford, Kent, TN27 5EH.
Feathered trees - 14 (one tie per stake)
Selected standards - Type L1 (one tie per stake)
Heavy standards/Extra heavy standards - Type L3 (one tie per stake)

Ties for rootball and container grown trees shall be 20mm rubber tree balls in a figure of eight around the tree. Fixed to the stake with two flat lead galvanised nails.
Feathered - one ball
Selected standards Type - two balls
Heavy standards/Extra heavy standards - two balls

Planting of trees
The tree shall be set upright and at the same depth as grown in the nursery, the roots shall be spread out (bareroot) and the soil followed by compressed topsoil medium, backfilled. Backfilling should be done to ensure close contact between roots and by firming in layers (bareroot). The soil shall be left level and tidy, any raised clods, bricks or stones over 50mm sizing, collected and kept off site.

Mulching
A 75mm compacted layer of medium grade pulverised bark, with a particle size of not more than 100mm and contains no more than 10% fines, shall be spread to form a continuous layer covering the whole of the bed, or in the case of standard trees within grass shall be in the form of a circle of 600mm diameter around the base of the tree. Whips and transplants shall be mulched in the form of a 300mm diameter circle around the base of the tree. Where trees are planted within grass a circular heavy duty mat is required beneath the layer of mulch at the diameter stated above, secured with fixing pegs. The tree pit surface shall be as big as possible.

TURFING
Soil preparation and cultivation
All areas to be turfed shall be cultivated to a depth of at least 100mm, all weeds, stones and debris larger than 50mm shall be removed to Contractor's tip, and shall be brought to a fine tilth. Allow for hand cultivation where machine work is not possible.

Turf
Turf shall be extra-quality meadow turf and shall comply to BS 3969: 1998 +A1: 2013 and shall be laid in accordance with BS 4428: 1989, section 6, Turfing. The Contractor shall supply a sample of the turf to be approved of the Landscape Architect and shall ensure that all turves are similar to the approved sample. The Contractor shall inform the Landscape Architect of the location of the supply, so that turf can be inspected prior to lifting.

Season
Turf shall be laid when weather and soil conditions are suitable and, where possible, preference should be given to autumn and early winter operations. No turf shall be laid in exceptionally dry or frosty weather or in other unsuitable weather conditions.

Delivery and stacking
For large areas, turf shall be delivered at appropriate intervals throughout the work so as to avoid stacking for long periods.

Laying
No turf shall be laid until the soil preparation has been satisfactorily completed by being brought to an even tilth and firmness. Turves from the stacks shall be wheeled to turf layers laid closely side by side. Adjacent turves shall be laid by hand using a trowel to support operations and barrow, and provide access. The turves shall be laid in consecutive rows with broken joints (waterbar bond), closely butted and to the correct levels. The turf shall be laid off plants working over turves previously laid. Where necessary, the turves shall be tightly and evenly limed with wooden beaters, the bottom of the beaters being frequently scraped clean of accumulated soil or mud. A dressing of fine (shred topsoil) shall be applied and well worked into the joints. Any irregularities in finished levels arising to variation in turf thickness or uneven consolidation of soil shall be adjusted by raking and/or packing fine soil under the turf. A roller shall not be used. The finished levels of the turf shall conform to the levels indicated, allowing for final settlement. Turf edges and margins shall be laid with whole turves. Turves adjoining buildings, walls or fences shall be taken to the face of the structure, giving complete soil cover.

Laying around trees
Turf shall not be laid to within 300mm of any tree trunk.

Watering
The Contractor shall be responsible for the replacement of any sowed turf. All necessary watering shall be carried out with sprinklers or oscillating sprays as an aid to wash soil out of joints. If shrinkage occurs and the joints open, the topsoil shall be brushed in and well watered.

PROTECTION TO EXISTING TREES
The recommendations in BS 5837: 2012, Trees in Relation to Design, Demolition & Construction must be complied with at all times. No pruning, topping, lopping or removal of roots is to take place without prior consent of the local authority.

Any work to the existing trees is to be carried out by a qualified tree surgeon. The position and construction of protective fencing shall be agreed with the local authority prior to any site works commencing. Under no circumstances must any materials be stored under the canopy of existing trees, and no cement, plaster or oil stored near them.

No vehicles should pass under the canopy of existing trees. No fees should be levied in close proximity to existing trees. No poles, cables, services or overheads shall be laid to existing trees. Under no circumstances shall the levels around existing trees be either raised or reduced.

Scaffolding may only be erected within protected areas if it is done so in accordance with BS 5837. Any excavations under existing tree canopy spreads shall be done by hand.

MAINTENANCE
All maintenance to be carried out up to handover to the adopting authority/ householder from the date of planting and/or landscaping establishment. All dead, diseased, damaged plants must be replaced during the time unless the local Planning Authority states, in writing, any variation to this.

PLANTING

Table with 6 columns: Trees, Abbreviation, Species, Height, Girth, Specification, Pot Size, Number of Plants. Lists various tree species like Betula utilis, Malus tchotchonaki, Prunus 'Serravallo', Prunus padus, Sorbus domestica, Tilia cordata.

POT SIZE= B- Bareroot, RB- Rootball, C- Container, L-Libre

Table with 6 columns: Shrubs, Abbreviation, Species, Specification, Height, Pot size, Density, Number of Plants. Lists shrubs like Eranthis 'Autumnal Blue', Ceanothus 'Shepherdia crispus', Cornus alba 'Sibirica', Calluna vulgaris 'Gold Heart', Eustoma fortunei 'Silver Queen', Geranium 'Doronic Cream', Impatiens x marmoratum 'Friscolet', Hibiscus 'Mrs Winder', Kerria japonica 'Wendlandii', Ligularia 'Lionel Lincoln', Mahonia aquifolium 'Apollis', Rosa 'Red Maxima', Rosmarinus officinalis, Viburnum dentatum, Viburnum opulus 'Sterile'.

Table with 6 columns: Specimens, Abbreviation, Species, Specification, Height, Girth, Pot Size, Density, Number of Plants. Lists specimens like Buxus sempervirens, Juniperus virginiana 'Spikehead', Mahonia media 'Charity'.

Table with 4 columns: Sensory Plants, Abbreviation, Botanical Name, Sensory Value, Number of Plants. Lists plants like Cosmos atroroseus, Hakonechloa macra 'Aureola', Lavandula angustifolia 'Vera', Pulsatilla vulgaris, Filipa barbatia.



Table with 6 columns: Hedges, Abbreviation, Species, Specification, Height, Girth, Pot Size, Density, Number. Lists hedges like Buxus sempervirens, Prunus laurocerasus 'Obo Layton'.

wildlife meadow






Table with 2 columns: Cultivar Name, % Breakdown. Lists cultivars like Bridge, Calceola Red, Calceola White, Crown Red, Gold Peppercorn, Delia, Drayton, Hush Meadow, Phoenix, Elbowest, Self-sown, Yellow Meadow, Yellow Rattle.

sowing rate 1.5-3.0g/m2

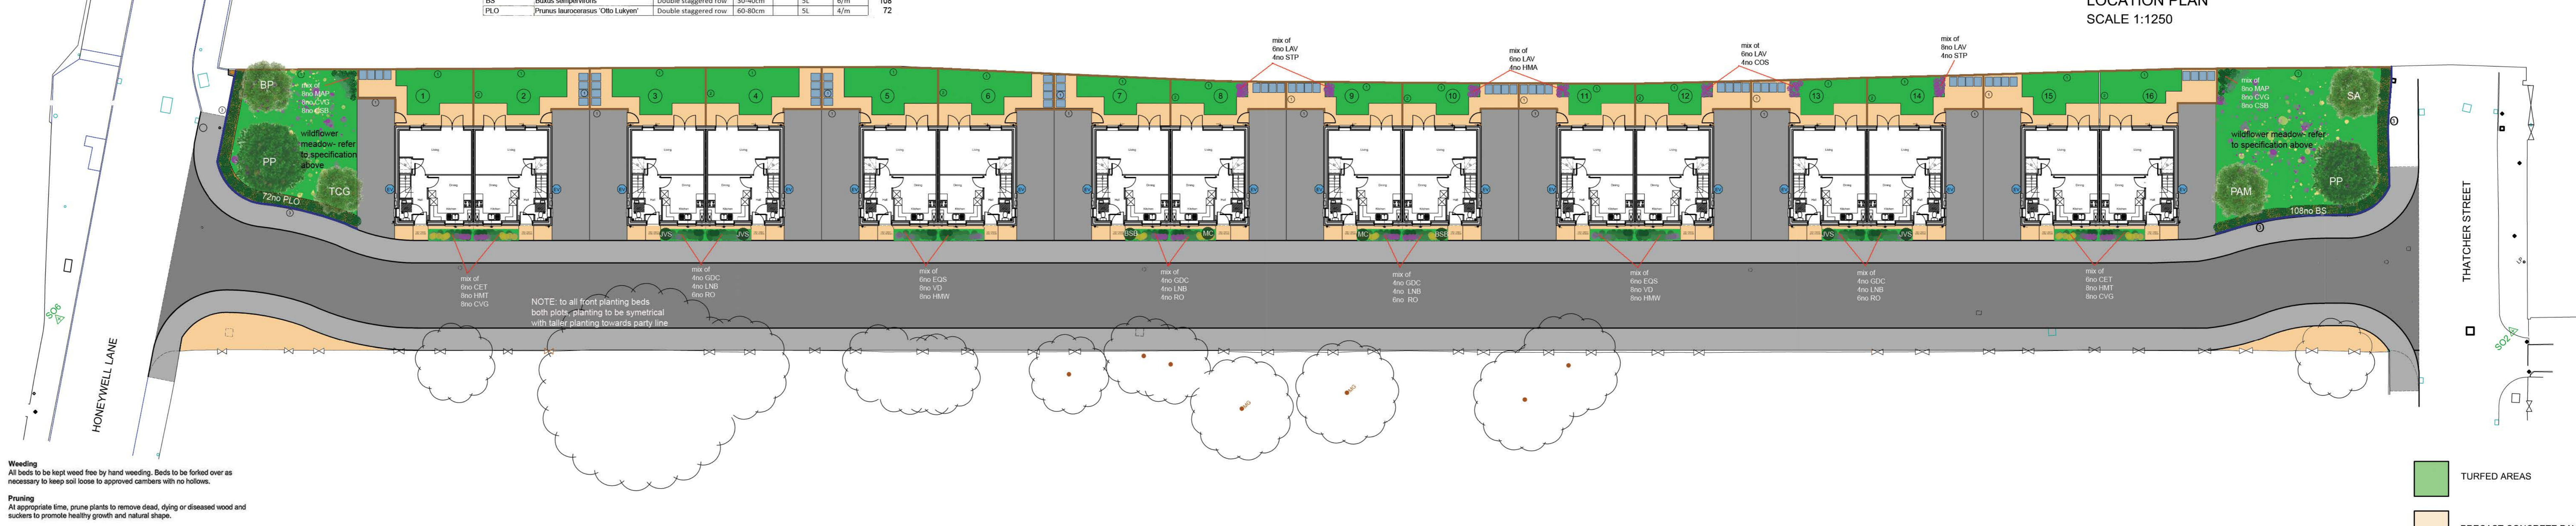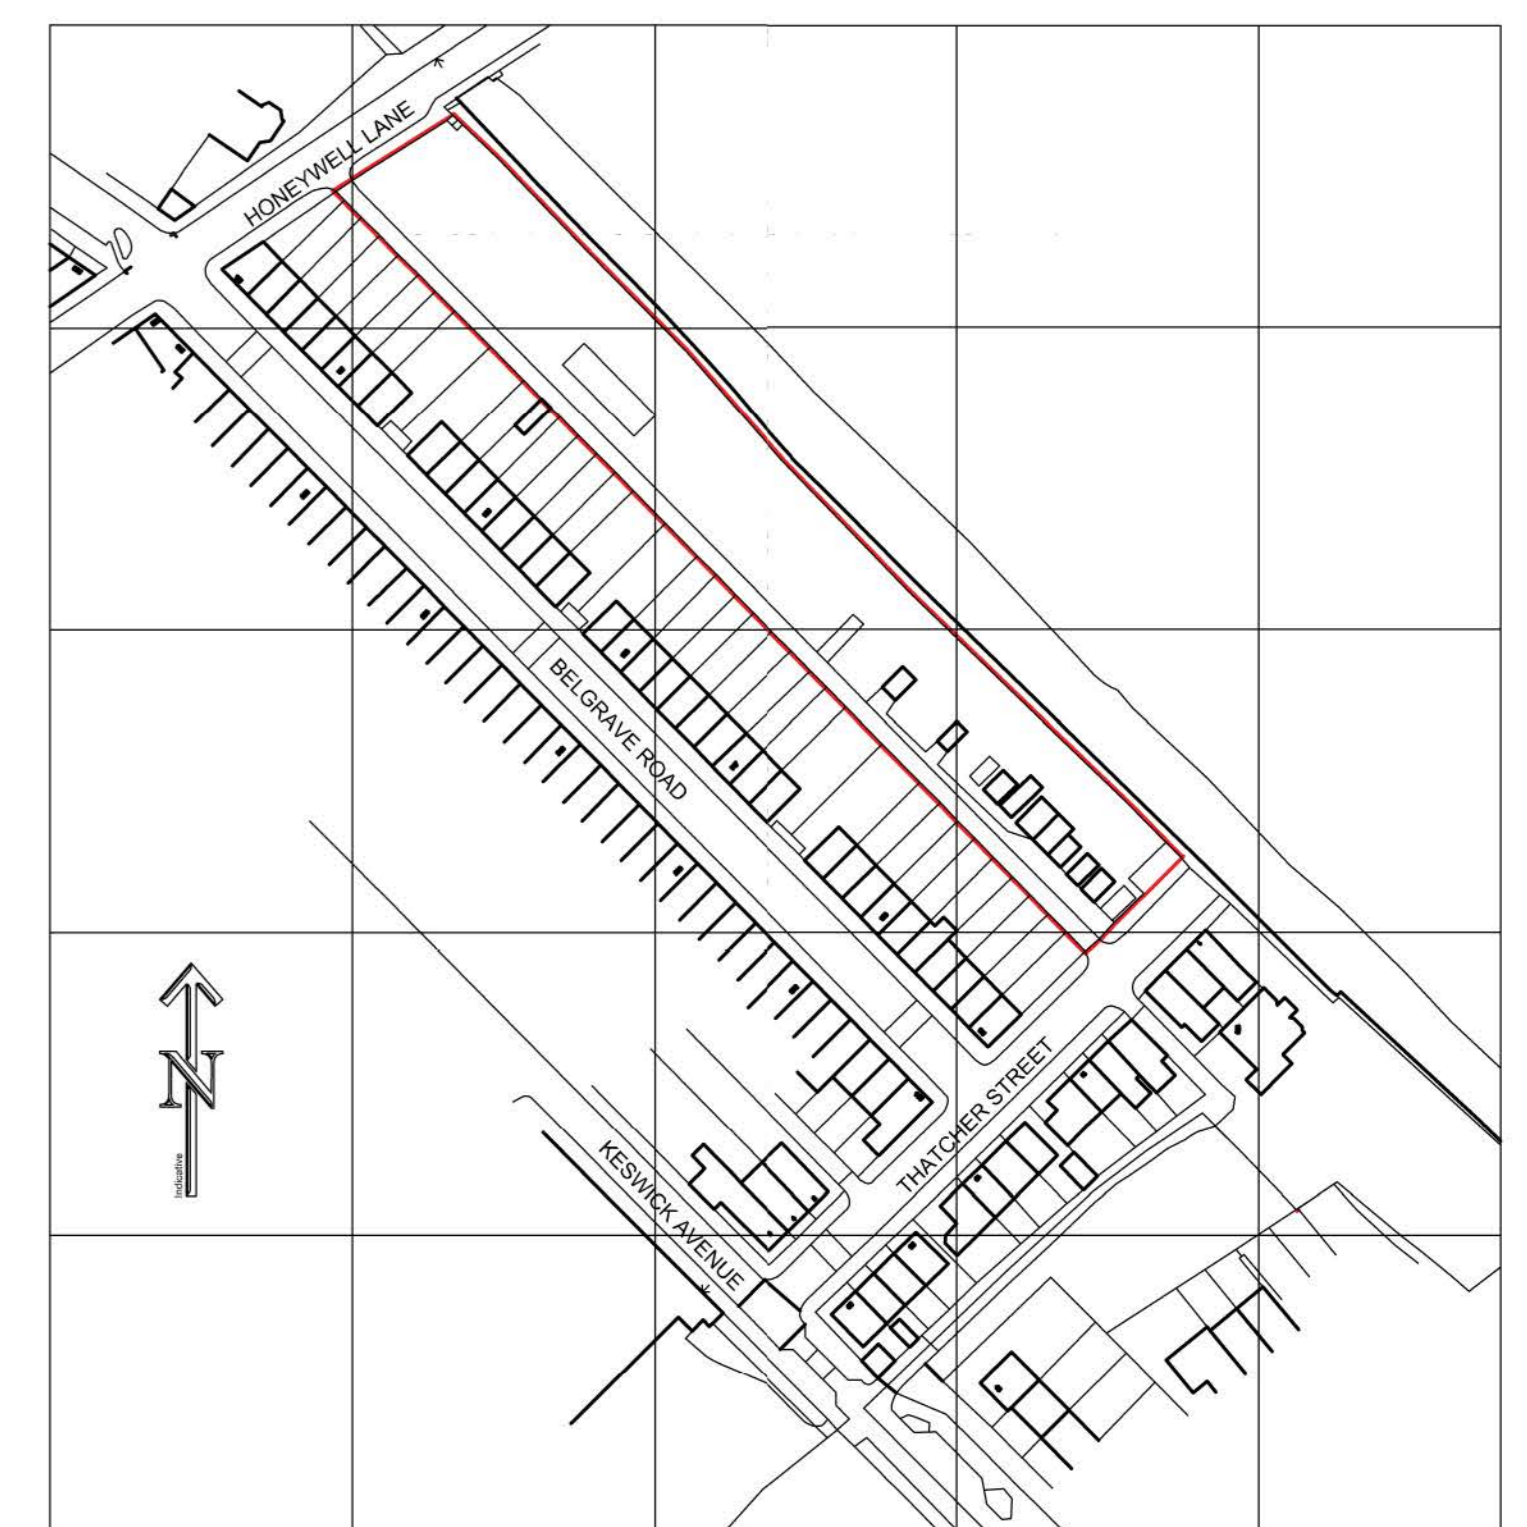

SCHEDULE OF ACCOMMODATION table with 3 columns: Description, Quantity, Total. Includes TYPE B - 3 BED 4 PERSON HOUSE - 84.4Sq.Metres (16No), SITE AREA - 0.39 HECTARES (16No Total), and 3 BED UNITS 200% CAR PARKING.

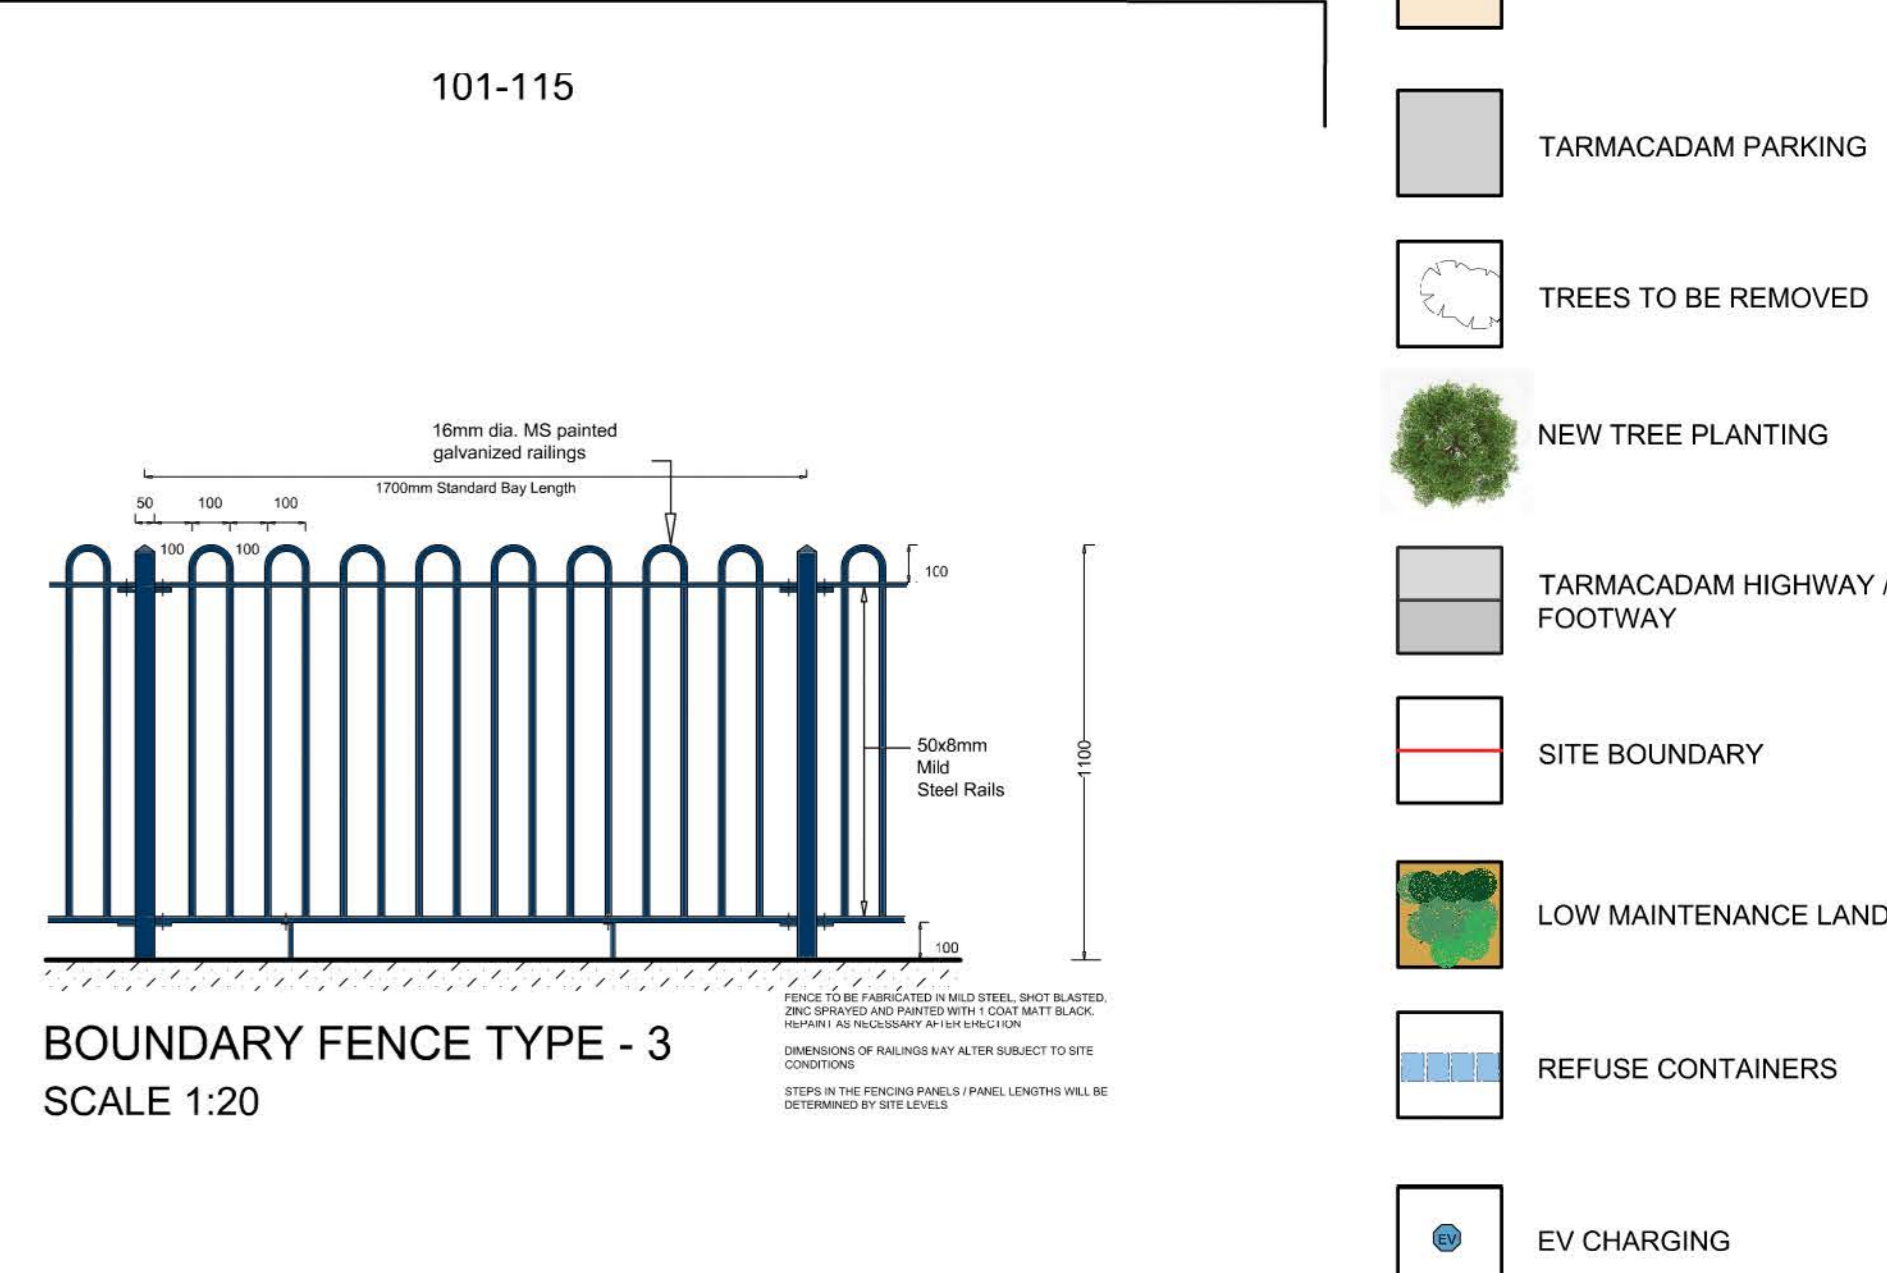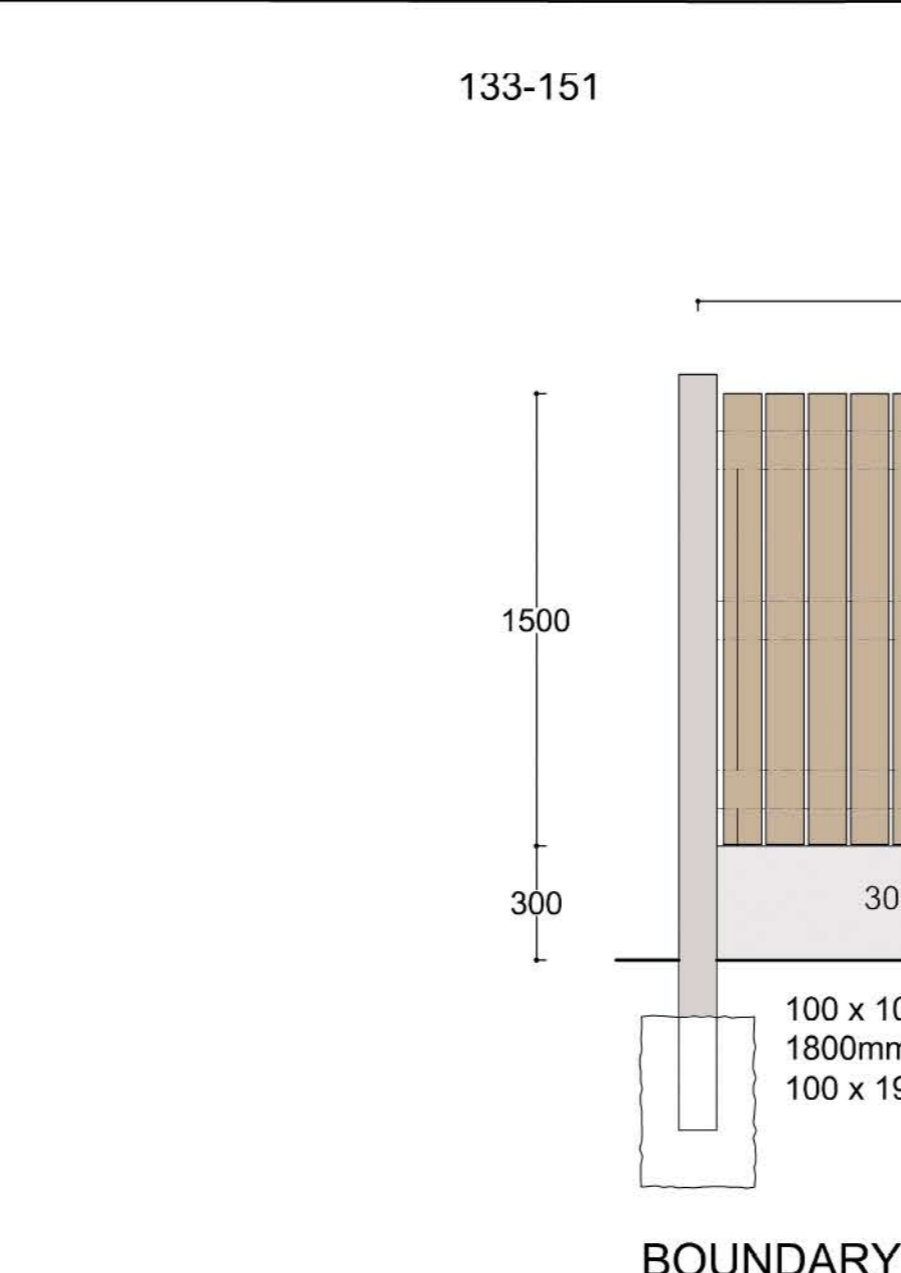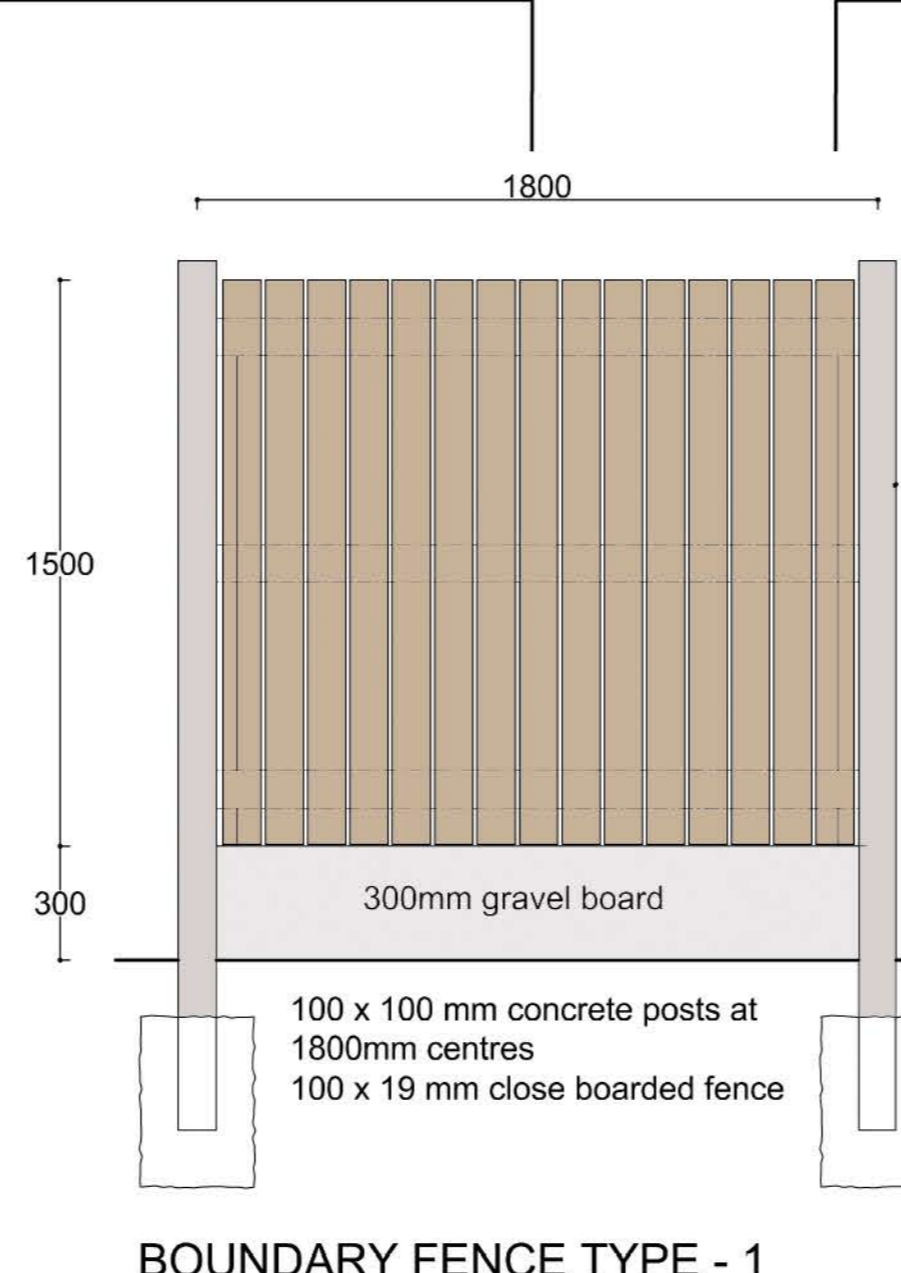

- TURFED AREAS
PRECAST CONCRETE PAVING
TARMACADAM PARKING
TARMACADAM HIGHWAY / FOOTWAY
SITE BOUNDARY
LOW MAINTENANCE LANDSCAPING
REFUSE CONTAINERS
EV CHARGING



Revision table with 3 columns: Revision, Date, Details. Contains multiple empty rows for revisions.

nicol thomas architects project managers construction cost consultants CDM co-ordinators Registered in England and Wales. Reg No. 2140639 Quality Assured to BS EN ISO 9001:1994 Certificate Number GB 4723 Heyside House Blackshaw Lane Heyside Royton Oldham OL2 6NS t:01706 290088 f:01706 290099 e:oldham@nicolthomas.com Also at Birmingham (Registered office) Do not scale from this drawing. All dimensions must be checked and verified before preparing production drawings or commencing works. This drawing and its design is the copyright of Nicol Thomas Ltd and may not be reproduced in any form whatsoever without their prior express written consent.

Client: HEATLEY DEVELOPMENTS
Job: BELGRAVE ROAD, OLDHAM
Drawing title: LANDSCAPING PROPOSALS
Drawing Number: M4625
Job number: LS1
Scale: 1:200 / 1:20 @A0
Date: JANUARY 2024
Drawn by/ checked by: GRF