



ROOF TO HAVE EXPLOSION  
RELIEF FITTINGS


EAVES VENTILATION  
TO BE PROVIDED TO  
3 SIDES (REAR & SIDES)

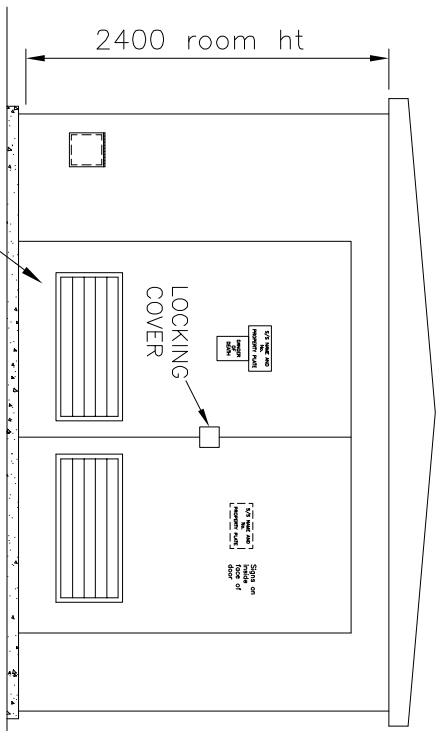


FRONT ELEVATION

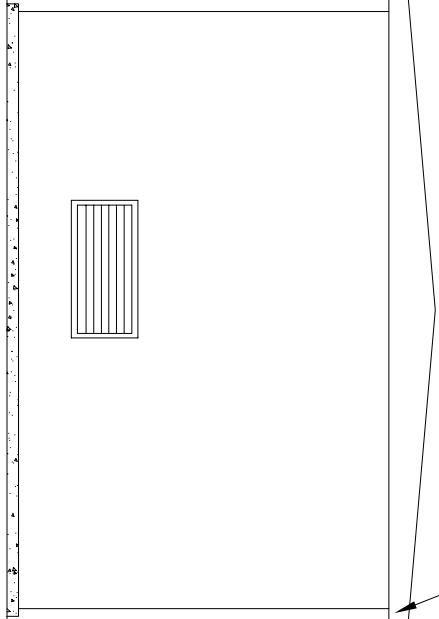

REAR ELEVATION

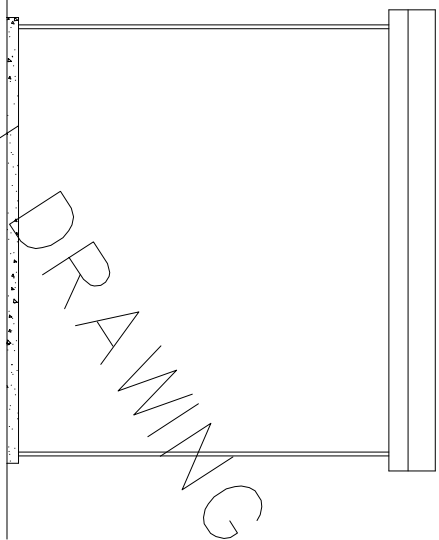


SIDE ELEVATION

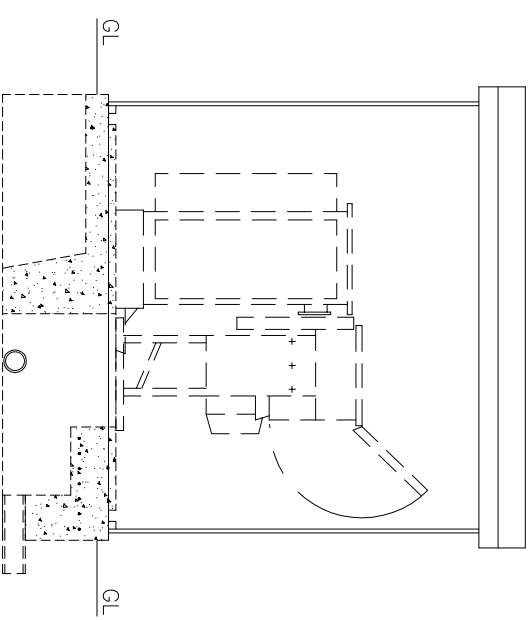


SECTION A-A

**NOTES**  
Substation doors to be set back a minimum of 1500mm from back edge of footpath. Any proposed reduction in this clearance to be approved by Northern Powergrid following submission of site specific risk assessment and operational method statement.

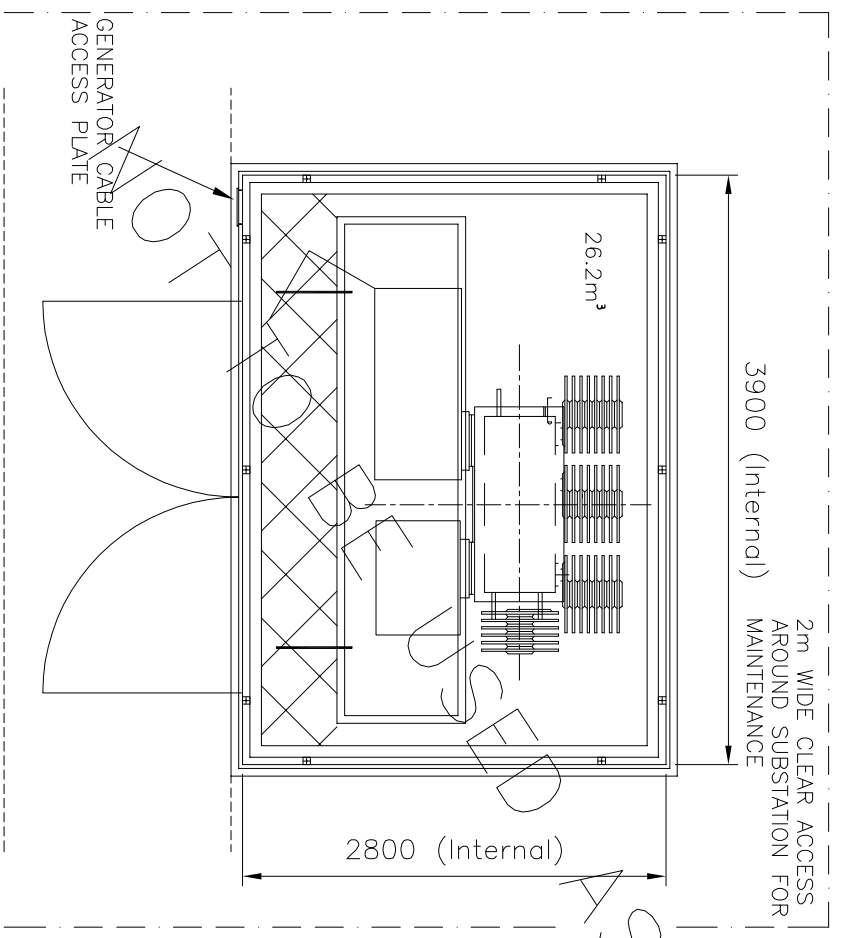

ELECTRICAL LAYOUT

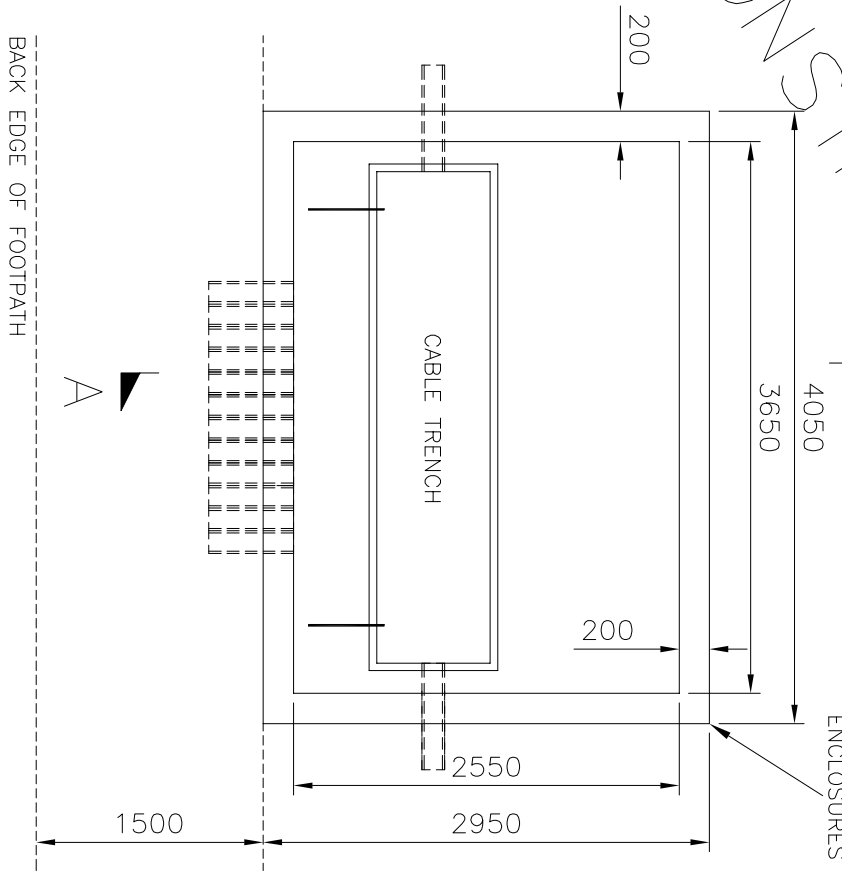

PLAN

		<b>Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF</b>	
Manufacturer Details		800 - 1000kVA UDE PREFABRICATED ENCLOSURE	
Sheet No.	1	Scale	AS SHOWN
Prepared By	TM	Grid Reference	
Revised		Ref No.	C993892
Date Issued	17.05.16	Checked By	JJ
		Revision	B
Document Details		GENERAL ARRANGEMENT / PLAN & ELEVATIONS	
Historic Drawing No.		C993892	