

Tees View ,Worsall Road,Yarm,

441,000

441,300

441,600

511,800


511,600

511,400

511,800

511,600

511,400

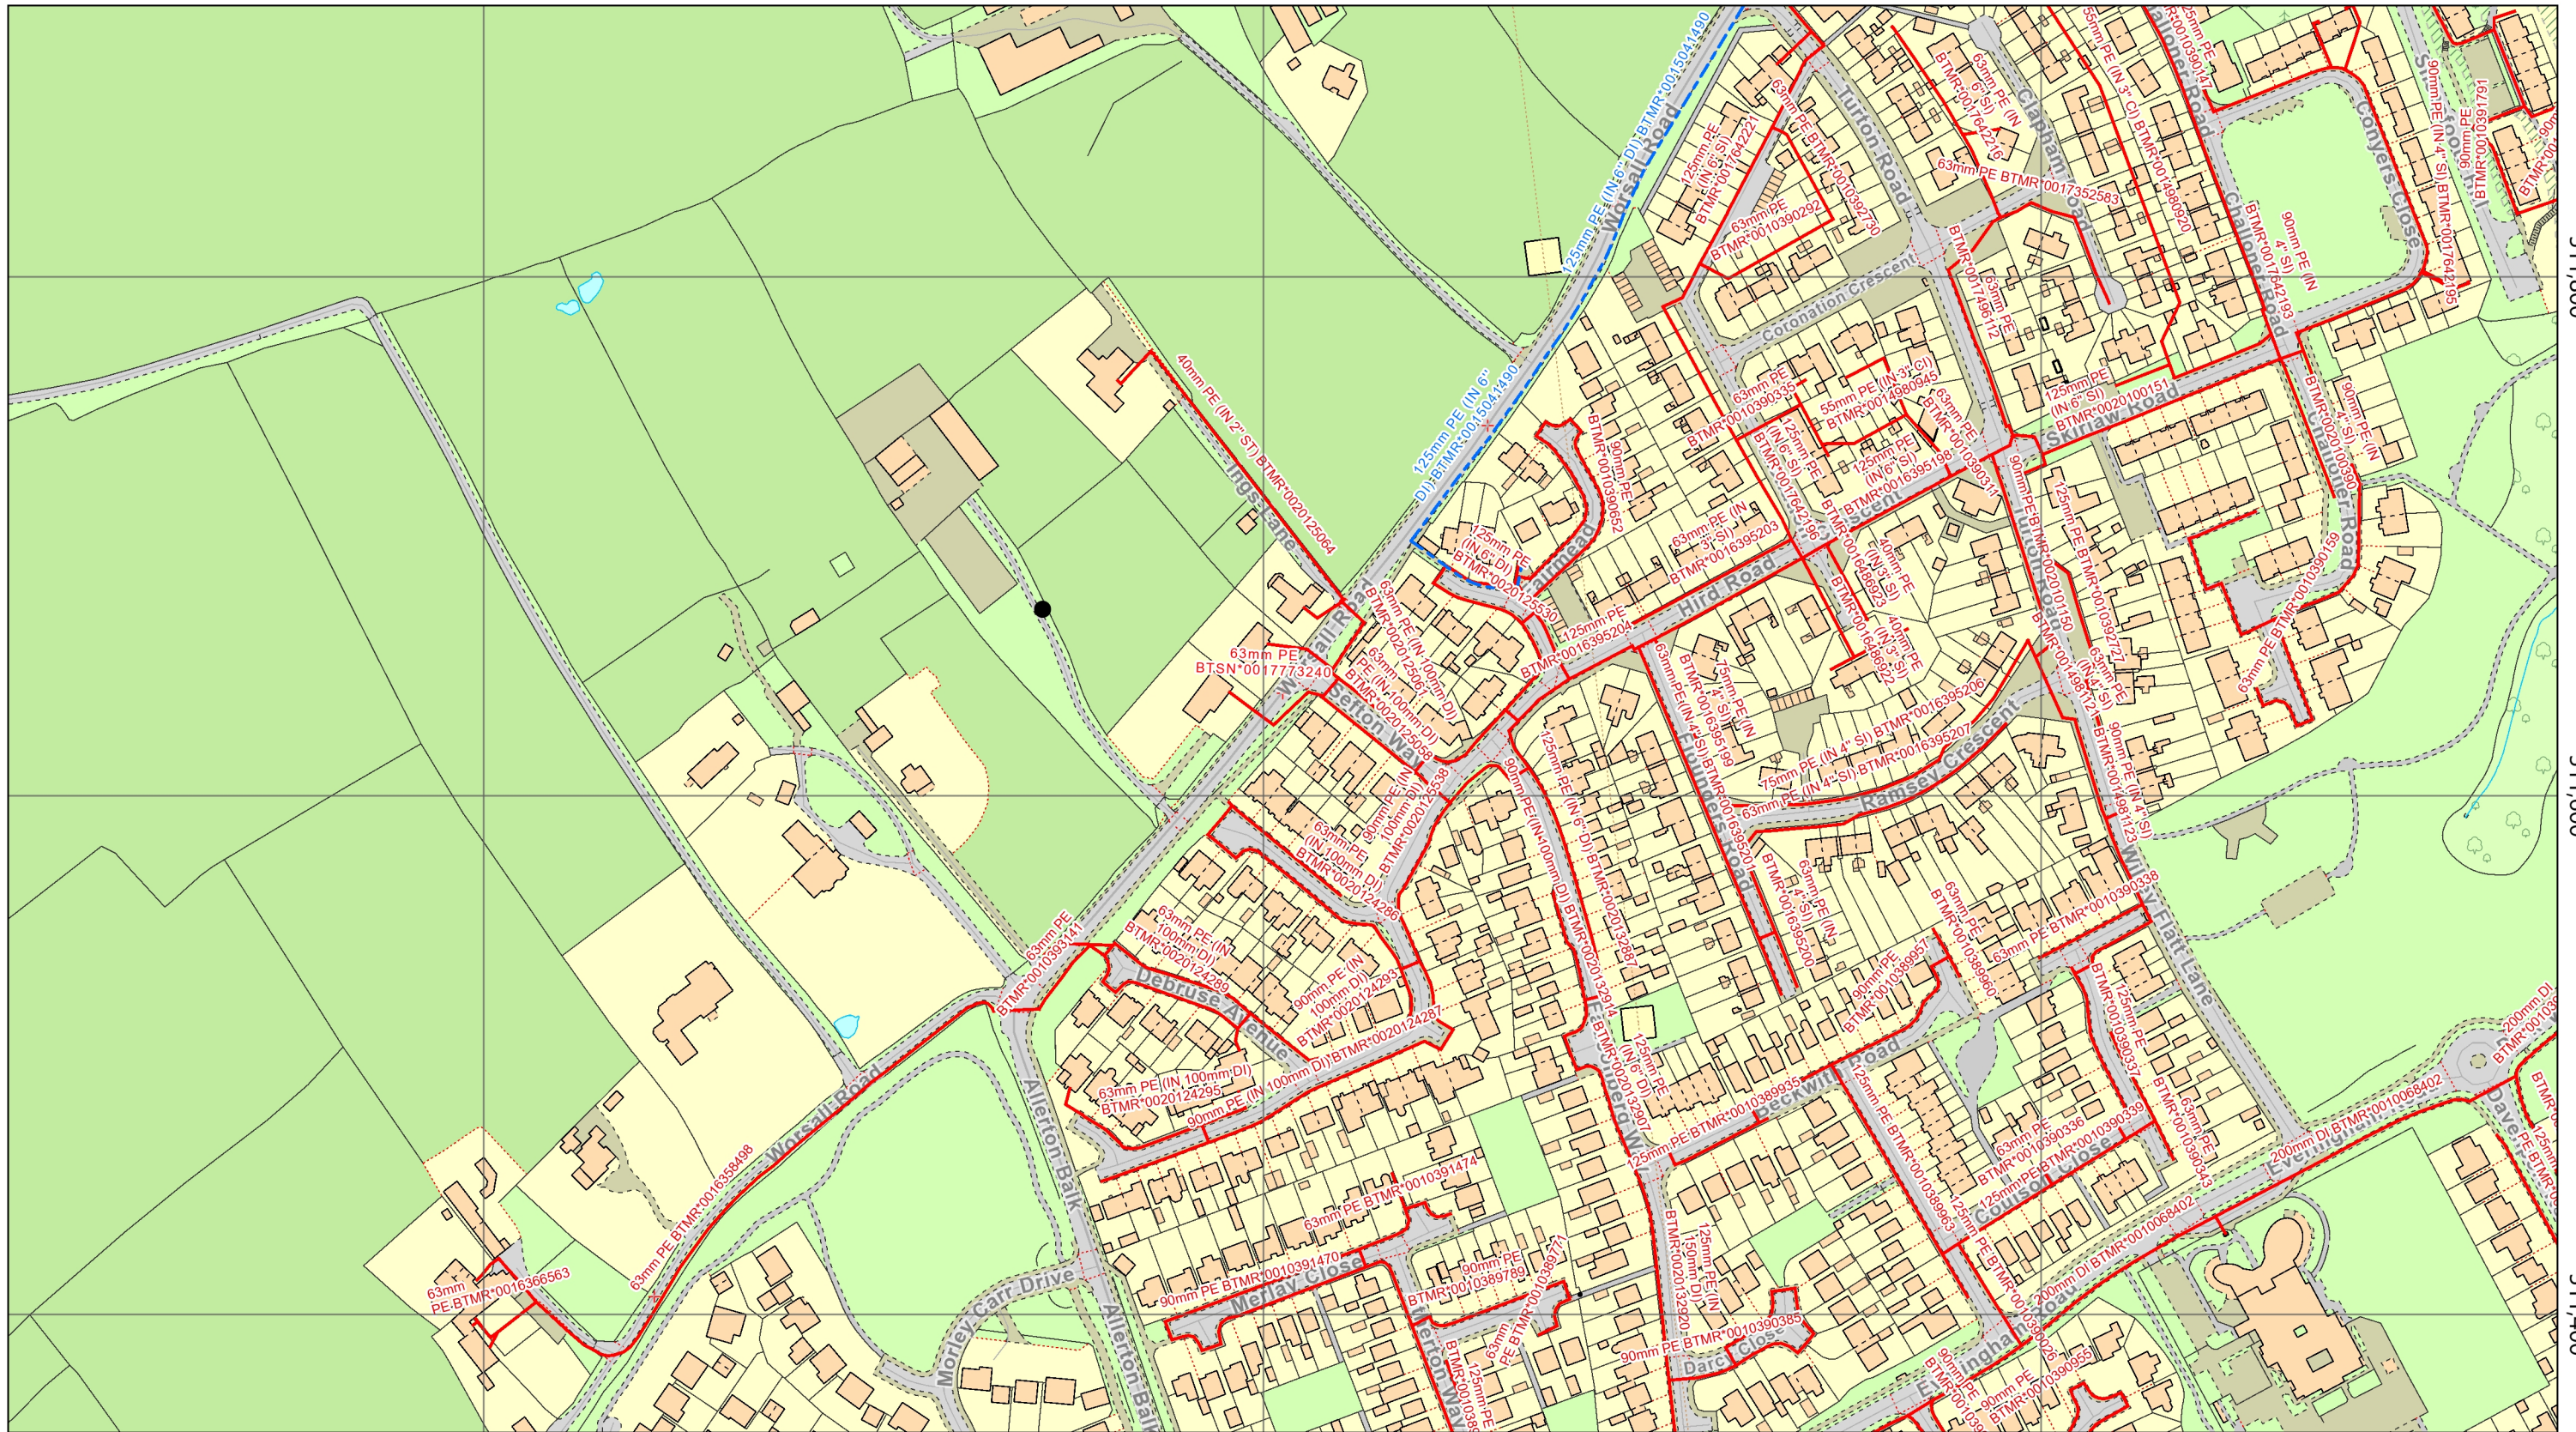


441,000

441,300

441,600

Legend

- Pipe with Terminations**
 - Main/Service Pipe (SP)
 - Main/Service Pipe (EP)
 - Transmission Pipe (ST)
 - Decommissioned Main/Service Pipe (ST)
- Pipe without Terminations**
 - Main/Service Pipe (SP)
 - Main/Service Pipe (EP)
 - Transmission Pipe (ST)
 - Decommissioned Main/Service Pipe (ST)
- Gas Network Assembly**
 - District Governor (SP)
 - District Governor (EP)
 - District Governor (MP)
 - District Governor (LP)
 - District Governor (GP)
 - Decommissioned District Governor
- Gas Network Device**
 - Flow Stop (MP)
 - MIG Point (GP)
 - Pressure Measurement (EP)
 - Pressure Measurement (SP)
 - Valve (EP)
 - Purge Point (MP)
 - Purge Point (EP)
 - Site Inlet Outlet (SP)
 - Site Inlet Outlet (EP)
 - Site Inlet Outlet (LP)
 - Site Inlet Outlet (GP)
 - Stand Pipe (MP)
 - Stand Pipe (EP)
 - Stand Pipe (LP)
- Non-Network Asset**
 - Change in Diameter
 - Change in Material
 - Creation Connection
 - Depth of Cover
 - Asset Protection Layers
 - Stabling
 - Steering
 - Prescribed Boundary
 - Legacy (Discontinuation Line)
 - Abandoned
 - At-Built
 - Scheduled Monument
 - SSO
 - Network Analysis
 - OTF Area
 - RTS
 - Contact Zone Area
 - Wayleaves
 - Elements
 - Properties
- Electric**
 - Cross Section - Call Marker Locations
 - Cross Section - Continued Locations
 - Underground Cables (120KV)
 - Underground Cables (132KV)
 - Underground Cables (175KV)
 - Underground Cables (220KV)
 - Overhead Cables (132KV)
 - Overhead Cables (175KV)
 - Overhead Cables (220KV)
 - Overhead Cables (330KV)
 - Overhead Cables (380KV)
 - Overhead Cables (500KV)
 - Overhead Cables (550KV)
 - Overhead Cables (800KV)
 - Overhead Cables (1000KV)
 - Underground Left in Situ Cables (120KV)
 - Underground Left in Situ Cables (132KV)
 - Underground Left in Situ Cables (175KV)
 - Underground Left in Situ Cables (220KV)
 - Overhead Left in Situ Cables (132KV)
 - Overhead Left in Situ Cables (175KV)
 - Overhead Left in Situ Cables (220KV)
 - Overhead Left in Situ Cables (330KV)
 - Overhead Left in Situ Cables (380KV)
 - Overhead Left in Situ Cables (500KV)
 - Overhead Left in Situ Cables (550KV)
 - Overhead Left in Situ Cables (800KV)
 - Overhead Left in Situ Cables (1000KV)



Disclaimer Information

This plan shows those pipes owned by Northern Gas Networks or the relevant Gas Distribution Network in their roles as Licensed Gas Transporters (GT). Gas pipes owned by other GTs, or otherwise privately owned, may be present in this area. Information with regard to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections, etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Northern Gas Networks, the relevant Gas Distribution Network, or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

This plan is reproduced or based on the OS map by Northern Gas Networks, with the sanction of the controller of the HM Stationary Office. Crown Copyright Reserved.

User ID	Donna Casey
Date	24/01/2024
Grid Ref	441307 / 511629
Advanced Plot	