

OUTSIDE

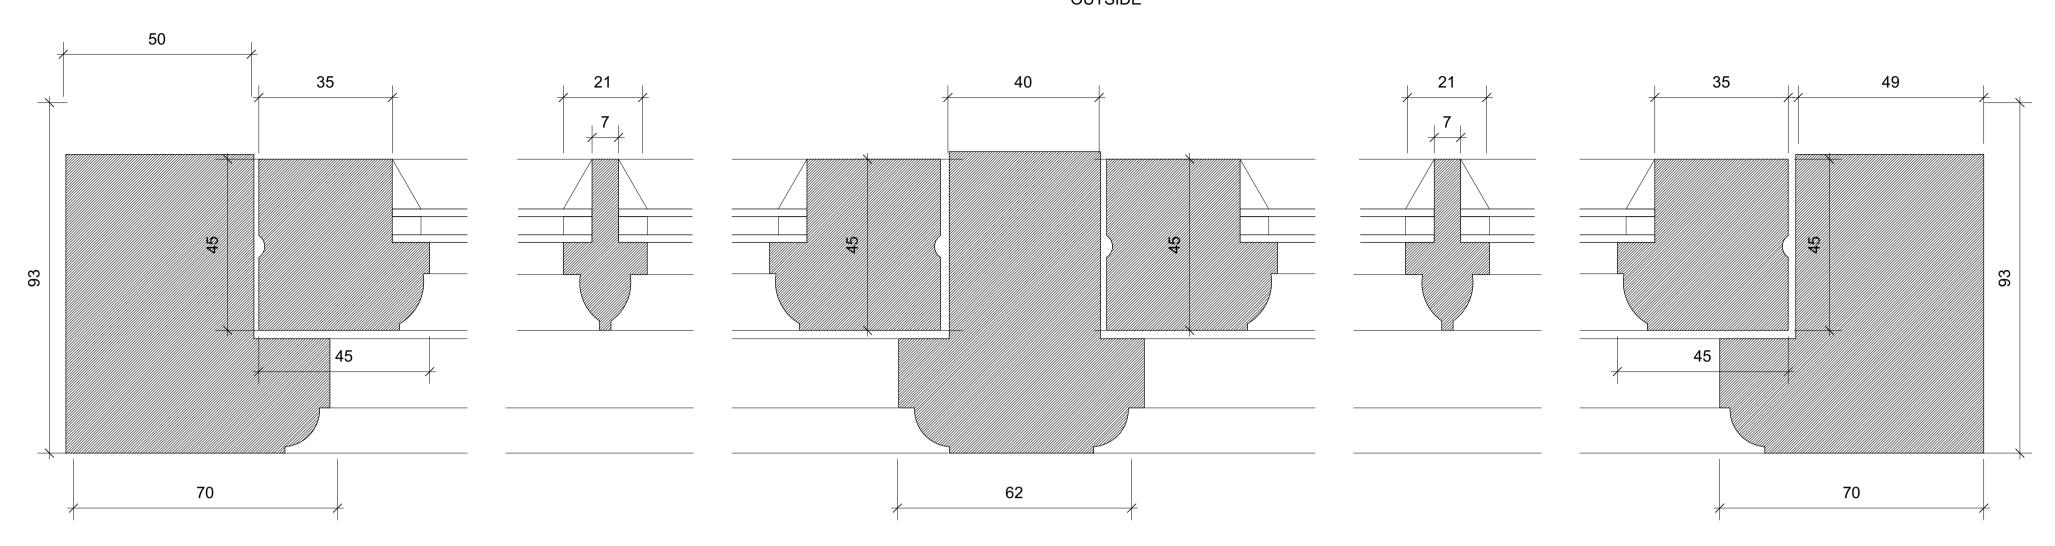

PROPOSED HORIZONTAL CROSS SECTION BRENTHAM CASEMENT WINDOW

INSIDE

OUTSIDE

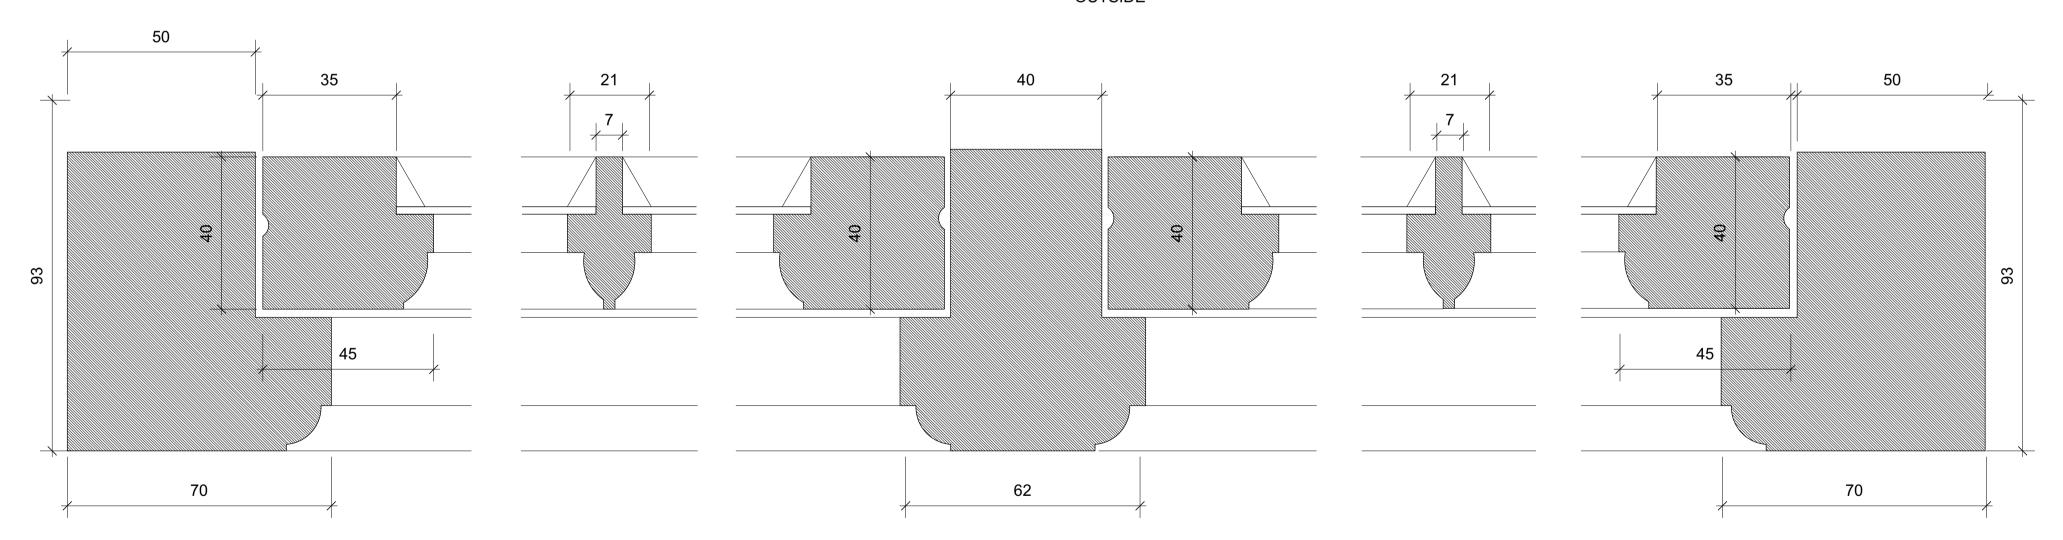

INSIDE

EXISTING HORIZONTAL CROSS SECTION OF BRENTHAM CASEMENT WINDOW

NOTES:

The agreed specification for Brentham CA: Slimlite or similar units, 14mm thick 4:6:4.

Units fixed into traditionally made timber frames with putty or putty substitute, not hardwood beads.

White or pale grey spacers set not protruding outside the glazing bar.

Hinges to align with guidance set out in Brentham Garden Estate Conservation Area design guidance which states:

"In cottage windows both hinges to be mounted so that that the whole hinge is recessed into the casement rather than the frame. This leaves the line of the frame clear around the casement and is a feature of Brentham cottage window design. Hinges to be painted to match the casement. Brass or stainless steel finish hinges are unsuitable."

The slightly increased depth of the frame to be accommodated inside.

Revisions :rNo :rDate :rApprNote	0	25 	50	100mm	This drawing should not be used to calculate areas for the purposes of valuation. Do not scale this drawing. All dimensions to be checked on site by the contractor and such dimensions to be their responsibility. All work must comply with relevant British Standards and Building Regulations requirements. Drawing errors and omissions to be reported to the architect/designer.	Job Number 3064 Drawn by XX	October 2023 Checked by	Scale 1:2@A3 Status Planning	Project 49 Holyoake Walk London W5 1QN Drawing	RIBA Chartered Practice Studio 163 Ltd hello@studio-163.com
						Drawing No. & Re 3063-DR-8		rialilling	Existing & Proposed Window Details	nello@studio-165.com