

**Arboricultural Method Statement, Impact Assessment and Tree Protection Plan in Accordance  
with BS 5837:2012**

**FOR**


**12 HEATHER GROVE, HARTLEY WINTNEY**

Individual trees were surveyed and plotted onto the site plan, with tree type, size and root protection zones plotted. None of the trees have TPO protection, The closest trees to the rear extension are located in neighbours' gardens, and are some 9.7m and 15.2m away from the works.

The two trees in question are noted on the aerial view below.



The site plan drawing below shows the two trees, along with the extent of the RPA zones. Officers will see that the works are some distance away from the RPA zones.

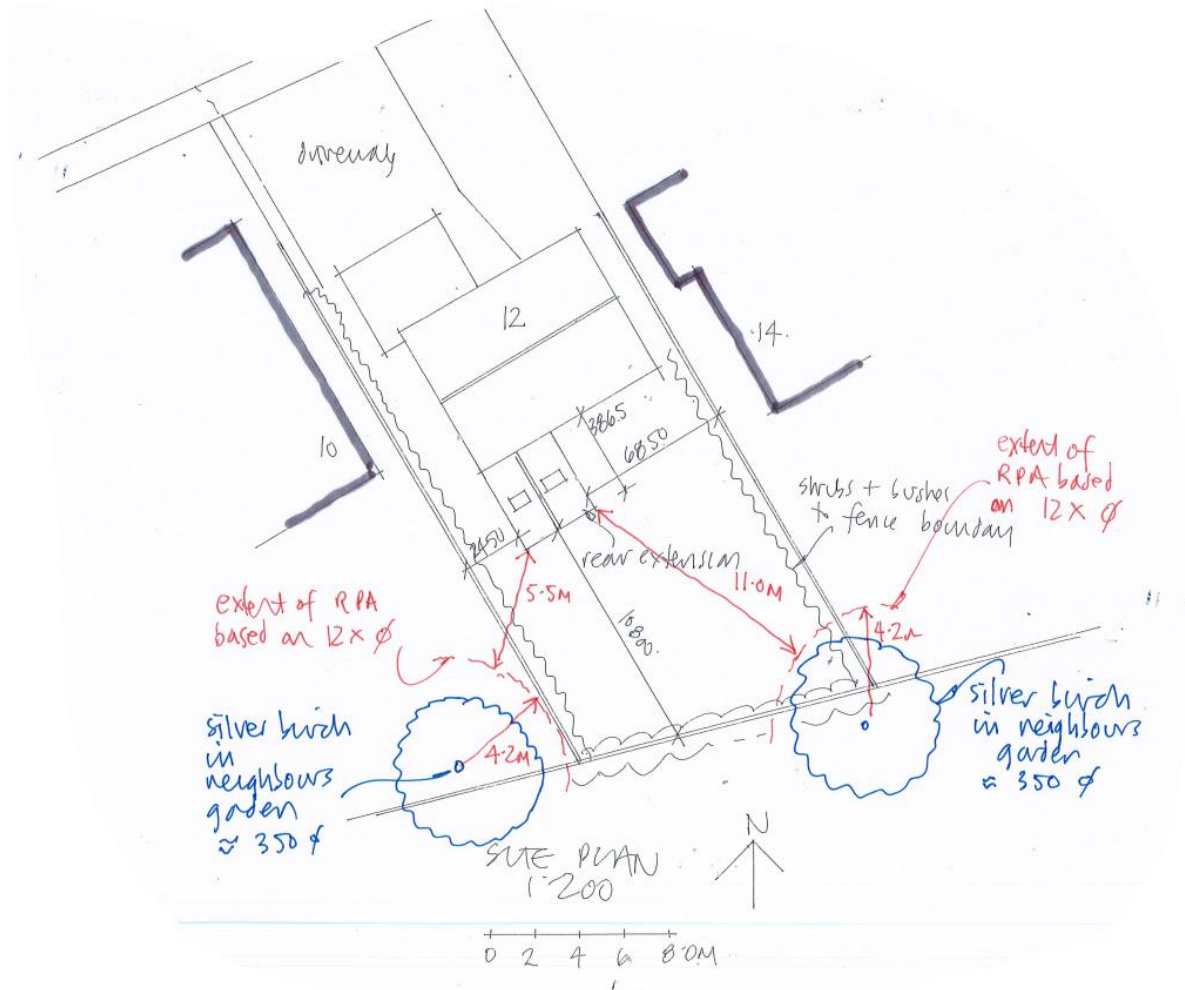

Tree Protection. Given the distance between the working area around the extension, and the rpa zones for the trees, it is not considered necessary to erect any herras fencing.

RPA – Root Protection Area. RPA's for single stem trees has been calculated as an area equivalent to a circle with a radius 12 times the stem diameter.

Conclusion:

The extension works, which comprise a rear extension, can be formed without impacting the trees near the site.