
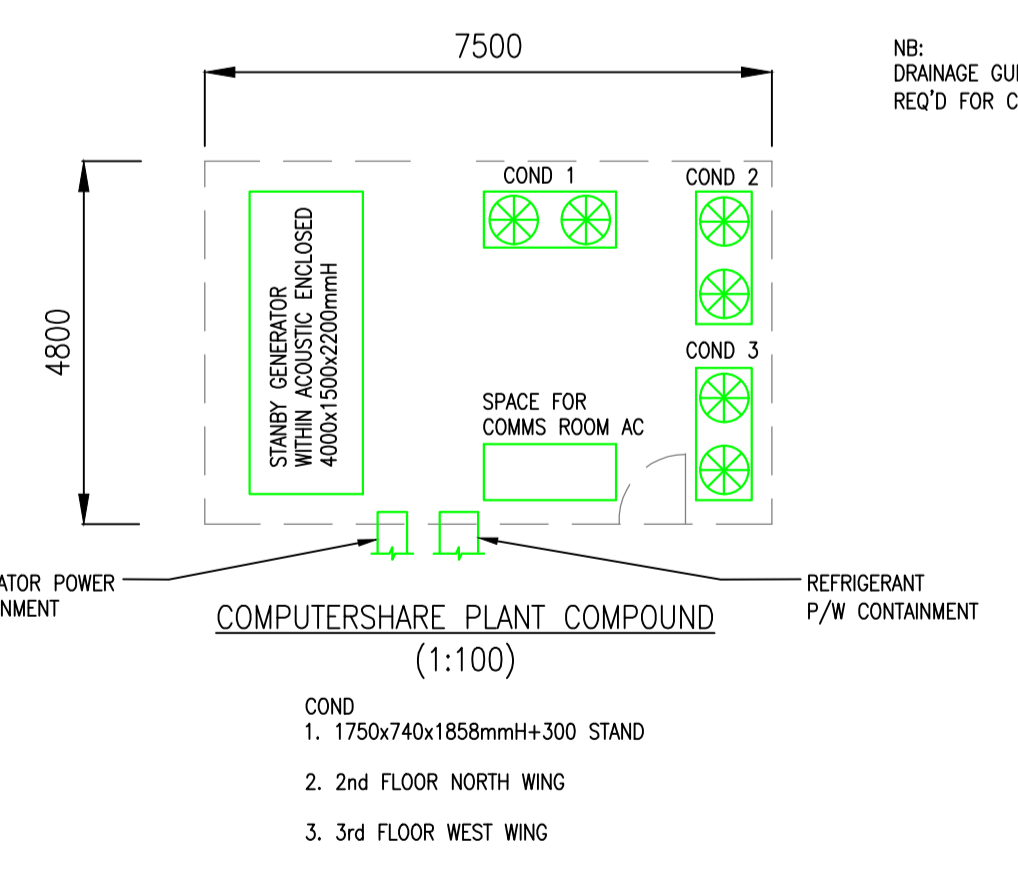
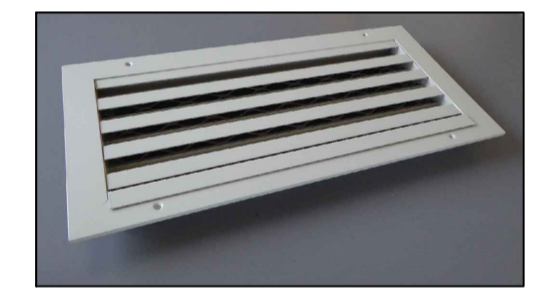


Notes:
 BASE ARCHITECT DRAWING - 203
 DATE RECEIVED - 29-01-24

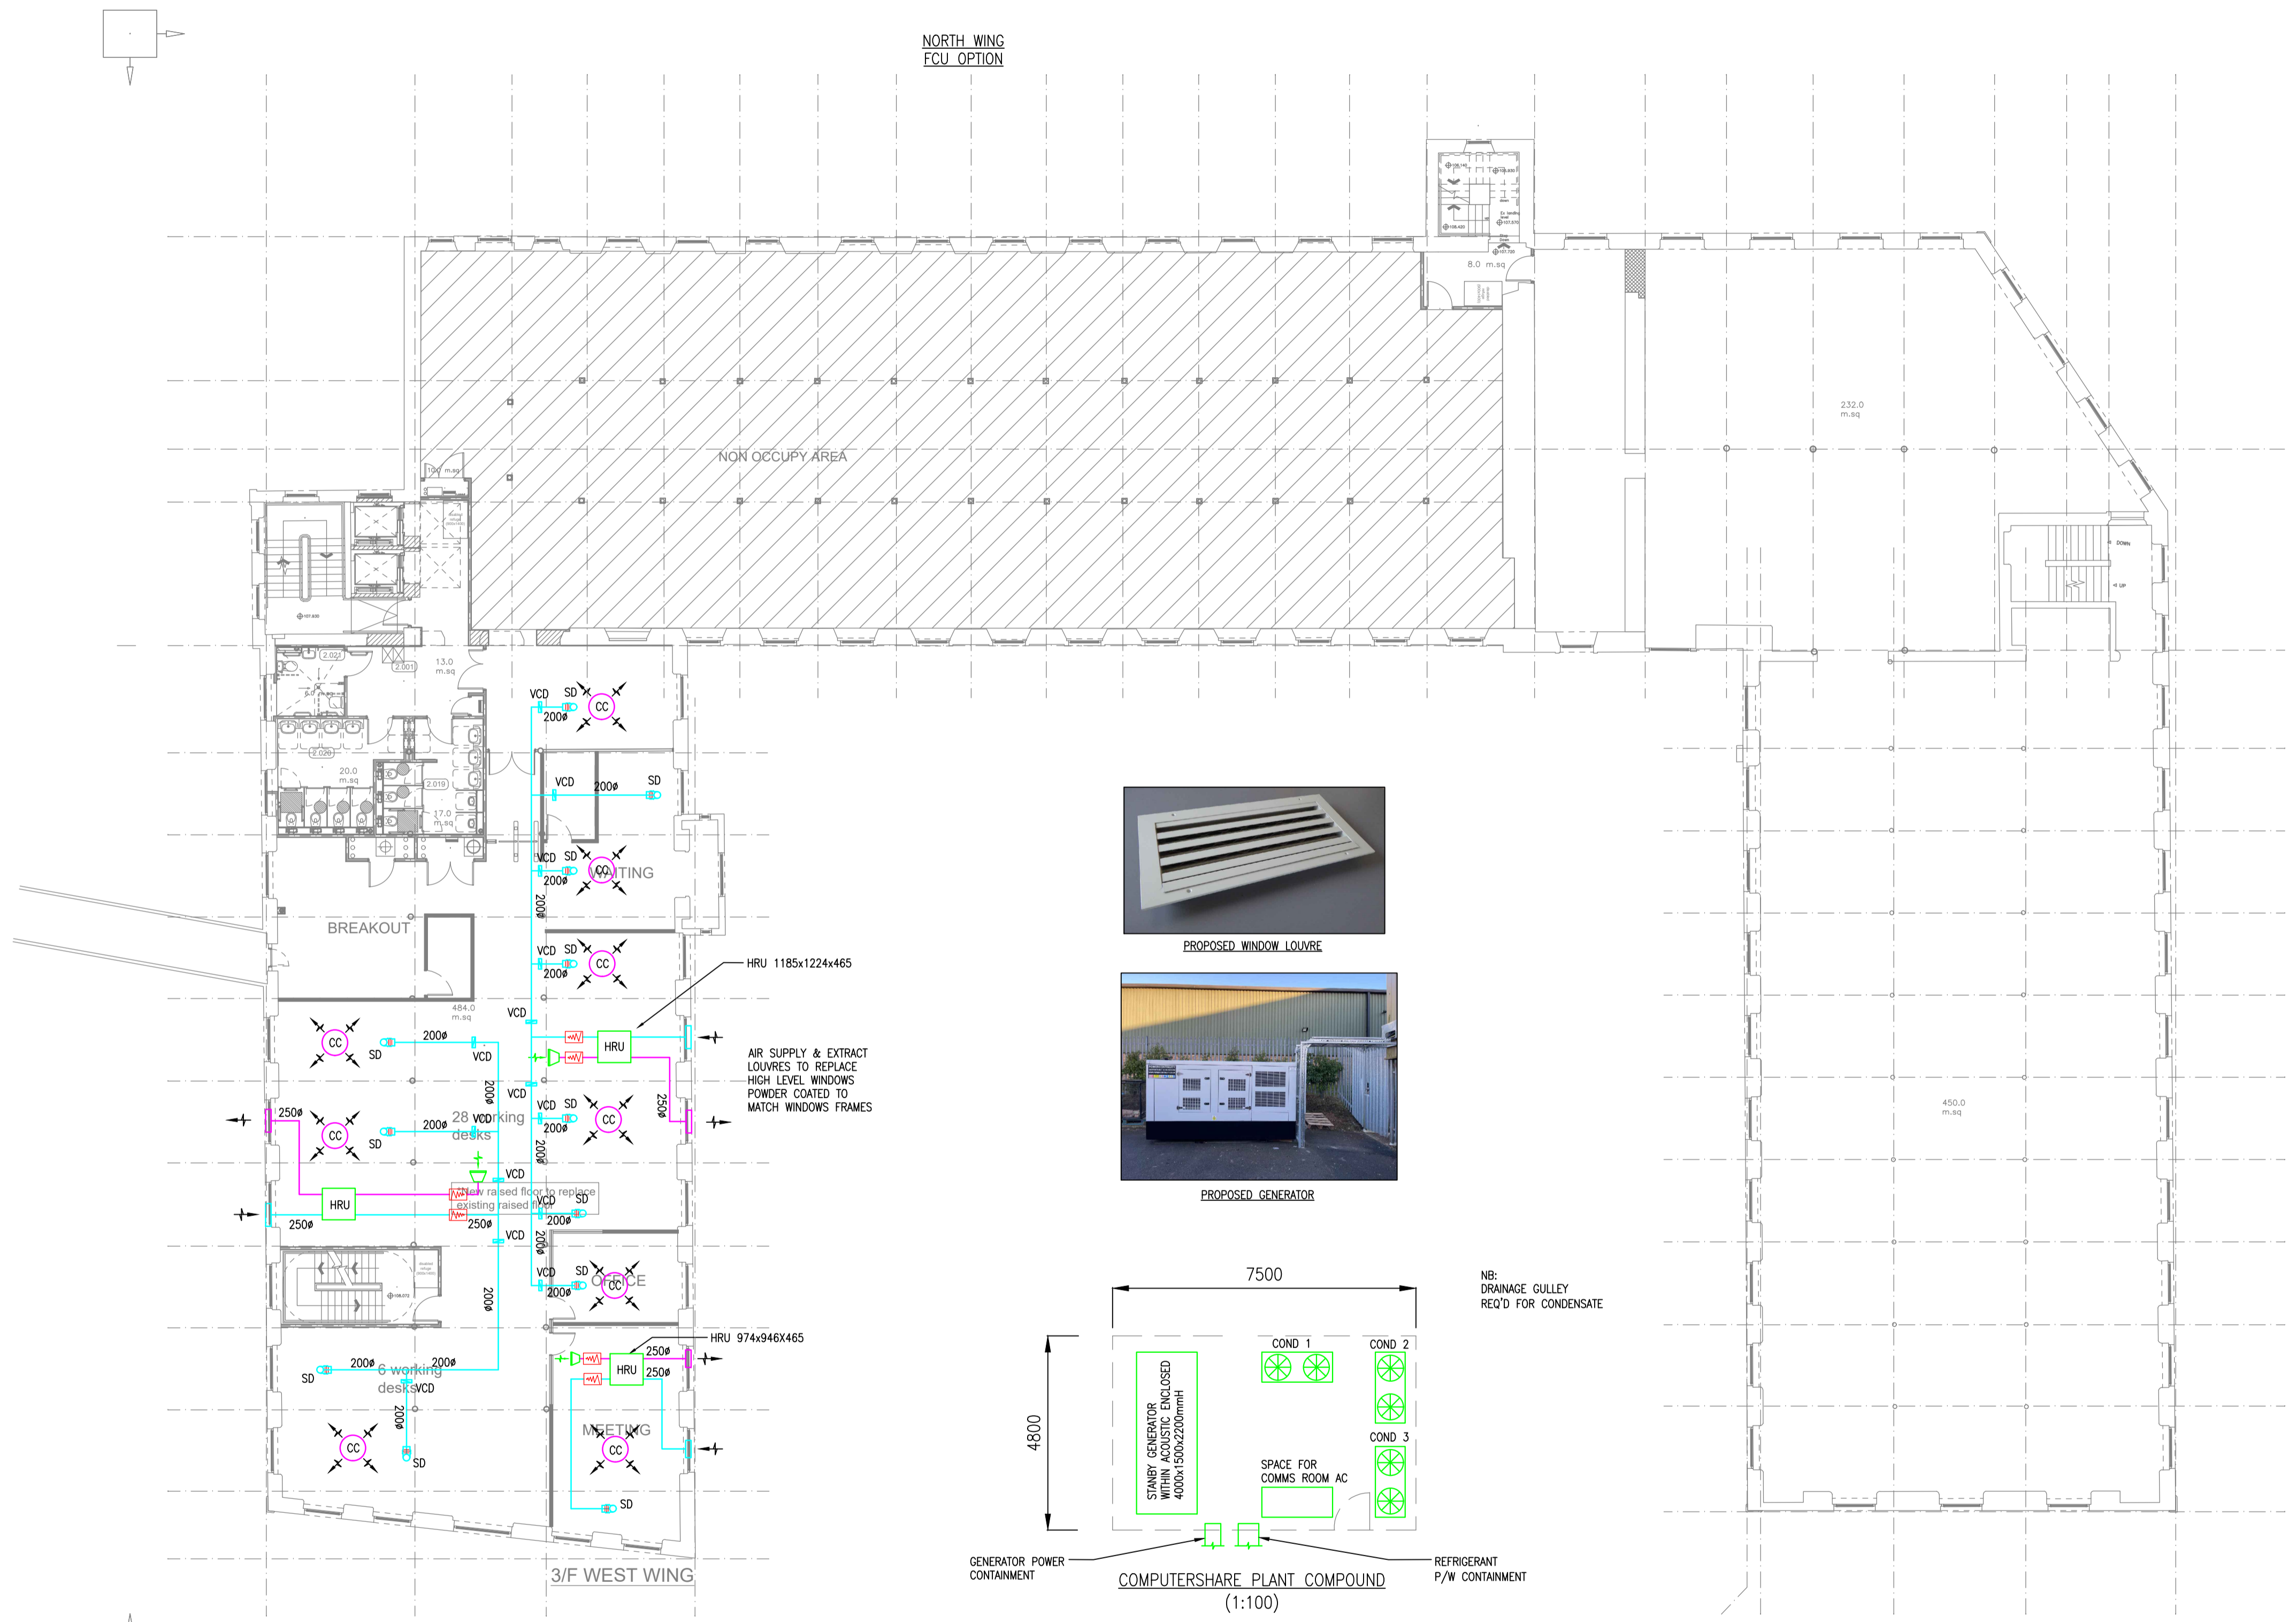

Legend:

- SAMSUNG 360 CEILING CASSETTE CIRCULAR 947x281mm DEEP
 - HEAT RECOVERY UNIT MITSUBISHI LGH-80RVS-E 1185x997x465mmH C/W CO2 CONTROL
 - 250# CIRCULAR SWIRL DIFFUSER
- CIRCULAR CASSETTE
-

REV	DESCRIPTION	DWN	CHK'D	DATE
P5	AMENDED TO SUIT NEW LAYOUT	PLR	JH	15.04.24
P4	AMENDED TO SUIT NEW LAYOUT	PLR	JH	11.04.24
P3	PLANNING INFORMATION	PLR	JH	05.04.24
P2	AC UNIT & HRU MOVED TO CENTRE OF BARREL VAULT	PLR	JH	03.04.24
P1	PRELIMINARY ISSUE	PLR	JH	30.01.24

STATUS	DESCRIPTION	DWN	CHK'D	DATE
PRELIMINARY ISSUE				

DWN	DATE	CHK'D	DATE	APP'D	DATE	SCALE
						1:150

CLIENT

PROJECT
SKIPTON BUILDING SOCIETY

TITLE
HVAC OPTIONS
THIRD FLOOR



DRAWING No.	REV
22604(50)SK02	P5