From: ukpowernetworks@safedigs.co.uk <ukpowernetworks@safedigs.co.uk>

Sent: 08 May 2024 10:19:58

To: Planning Reps

Cc:

Subject: Plant Enquiry Ref Job No. 33336857

Attachments: UKPN 33336857.pdf; UKPN Customer Letter.pdf; Excavation leaflet DIGGER.pdf; South+of+England.pdf

CAUTION: This email originated from outside of the organisation. Do not click links or open attachments unless you recognise the sender and know the content is safe. Remember your cyber security training and report anything suspicious.

08/05/2024

LinesearchbeforeUdig ref: 33336857

Your ref: DA/24/00510/FUL

Dear Sir/Madam,

Thank you for contacting us

Please see attached information specific to your enquiry:

- 1. Plan (Please print in colour)
- 2. Letter
- 3. Other safety related information: Think+before+you+dig+underground.pdf

The Plan is an extract from our mains records of the proposed work area enclosed for your guidance. This plan only shows the cables and overhead lines owned by UK Power Networks. Please note that privately owned electricity cables or ones owned by other Independent Network Operators may be present in this area and information regarding those cables needs to be requested from the owners.

The accuracy of the information shown on this plan cannot be guaranteed. Please read the information and disclaimer on these plans carefully. The information included on the plan is only valid for 3 months however please note our data is updated daily.

A colour copy of these plans and the safety advice booklet enclosed should be passed to the senior person on site in order to prevent damage to our plant and potential direct or consequential costs to your organisation.

Safe digging practices, in accordance with HSE publication HSG47 "Avoiding Danger from Underground Services" must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all relevant people (direct labour or contractors) working for you on or near electricity assets.

Damage to our cables can be extremely dangerous for your employees and the general public.

If you require any further information please contact the number below.

Network Feedback Tool

To help improve the accuracy of its electrical asset plans, UK Power Networks is inviting all users to submit feedback when they have worked around its network. Providing information on any inaccuracies, damage or missing network, could help UK Power Networks to enhance their plans and try to ensure safer working for others.

It should only take a few minutes of your time and any response will be greatly appreciated.

will take you to the feedback form.

Alternatively, you can use your mobile device to scan the QR code provided in your plans package.

Yours sincerely,

<u>UK Power Networks</u>
<u>Plan Provision Team</u>
<u>0800 0565 866 Opt 1</u>
<u>plans@ukpowernetworks.co.uk</u>










Every year, people are killed or seriously injured when they come into contact with high voltage electricity.


This can have a far-reaching and devastating effect on family, friends and colleagues.

Distractions, working long hours, rushing to get the job done, can all impact on how we work and our safety.

Taking time to plan, being prepared and focusing on the way we work can help keep us safe.













OUR NETWORK DISTRIBUTES ELECTRICITY THROUGH UNDERGROUND CABLES, PYLONS, OVERHEAD POWER LINES, SUBSTATIONS AND OTHER EQUIPMENT










TAKE NOTICE OF ANY YELLOW 'DANGER OF DEATH' WARNING SIGNS. AND STAY WELL AWAY!





OVERHEAD POWER LINES ARE OFTEN UNINSULATED (BARE)





RRY OBJECTS AND EQUIPMENT DRIZONTALLY AND AT LOW

TOUCHING ANYTHING IN CONTACT WITH ELECTRICAL EQUIPMENT, EVEN THE LOWEST OF VOLTAGES, CAN BE FATAL




The electricity network is designed to keep you safe. But how safe are you when you are working?

UK Power Networks is the country's biggest electricity distributor, making sure the lights stay on for more than eight million homes and businesses across London, the South East and the East of England.

The safety of our customers and staff is our top priority.

Underground cables carry a powerful electrical charge which can be conducted through machinery and equipment with fatal consequences. Anyone working close to live underground cables should take the time to read this simple leafret and identify the precautions they should be taking.



Remember:

- The depth and location of cables and services shown on the plans may have changed because of subsequent site alterations
- Be aware that not all cables and services may be shown on the plans
- Cables do not run in straight lines. Underground cables may be deflected around underground obstacles and can change depth
- Wear Personal Protective Equipment to minimise the harm of electric shock and burns

If you are building a permanent or temporary structure within close proximity of power lines it's a legal requirement* you notify us in advance to ensure your building is kept at a safe distance from power lines, and to avoid the need to relocate our equipment in the future. This can be done by completing a simple form here www.ukpowernetworks.co.uk/notifyus 'Regulation 18(3) of the Electricity, Quality & Continuity Regulations 2002 (ESQCR)



How can we help?

If you work or live in the UK Power Networks area contact us or look on our website. We provide free information and advice about the precautions and safe working practices to be followed when working close to electrical equipment.

Further advice and guidance is available from the Health and Safety Executive (HSE):

HSG85 - Electricity at Work –Safe Working Practices GS6 - Avoiding Danger from Overhead Power Lines HSG47 - Avoiding Danger from Underground Services

What to do in an emergency

If a mains electricity cable is damaged:

- STOP WORK IMMEDIATELY
- Notify UK Power Networks: Dial 105
- If you damage a cable, stay calm, keep clear, and call for help
- Call the emergency services if anyone is injured or there is a fjre. Anyone who has received an electric shock should go to hospital as damage may have occurred to the heart
- Always treat the cable(s) as live even if they are not sparking
- Never remove anything that is stuck or in contact with the cable
- Stay clear keep everyone away until assistance arrives



To request your FREE vehicle cab stickers visit the safety pages at www.ukpowernetworks.co.uk

If you are unsure who your network operator is then please visit www.energynetworks.org



You could be in danger when carrying out your everyday trades activities such as digging, construction and demolition.

- Contact UK Power Networks or Line Search Before U Dig (LSBUD) in advance of the works to obtain relevant cable plans or to request disconnections. The cable plans will only show the indicative route and not the route into the property
- Ensure the cable plans are shown to and understood by those on site BEFORE starting work
- Confirm the cable location by using a Cable Avoidance Tool (CAT) before digging commences. Once found, mark cable positions with spray paint or similar

For cable plans visit www.lsbud.co.uk or www.ukpowernetworks.co.uk

- Complete a risk assessment and ensure it covers electrical hazards
- Tuse spades and shovels with insulated handles in preference to forks and picks
- Look around for anything in the vicinity that would have an electricity service such as street lights, CCTV cameras, or meter boxes and identify where the cables are
- Look for electrical wires, cables and equipment near to where you are going to work and check for warning signs and any other hazards
- Contact UK Power Networks to agree a safe method of work if there is a cable encased in concrete, DO NOT BREAK OPEN
- Make sure everyone on site is aware of the presence and location of electrical cables
- Before demolishing a building make sure supplies are disconnected, preferably well clear of the work area. For guidance on how to arrange a disconnection visit www.ukpowernetworks.co.uk







Stop! Think before you dig!

#bebrightstaysafe






/ ukpowernetworks

National power cut helpline

POWER CUT? CALL 105 Or call us 24 hours a day on 0800 31 63 105



To report broken or damaged electrical equipment or in an emergency call 0800 31 63 105 or 105 and use what3words to help us locate you faster.

For safety advice about overhead power lines, disconnections and general enquiries, go to: www.ukpowernetworks.co.uk

To request your FREE vehicle cab stickers visit the safety pages at www.ukpowernetworks.co.uk

If you are unsure who your network operator is then please visit www.energynetworks.org







Network Records NetMAP Symbols Booklet South East England

Version 1.2

Released October 2010

Always check with your local Network Records office or the UK Power Networks server to ensure that you are using the most up to date copy of this booklet - Tel: 08000 565866

Index:-

Contents:

Page no:

i age		Contents.
1		Guidance notes.
2		The area covered by this guide.
3	1.500 (8 1.125	50) view
3	1:500 (& 1:125	
1		Scenery.
4 7		Scenery (UK Power Networks use only).
8		Primary distribution line route (EHV).
9		Secondary distribution cables (HV/LV). Secondary distribution cable terminology.
9 12		Cable ducts.
13		Poles.
14		EHV, HV and LV sites.
15		Joints.
16		Street furniture
17		Miscellaneous.
18		Connectivity.
19		Abbreviations.
_		
20 21		Cable phasing.
21		Operational status colours.
22	1:2500 view (L	JK Power Networks use only).
		Notes.
23		Primary distribution line route.
24		Secondary distribution cables.
25		Primary and secondary sites.
27		Switch types.
		• •
28	1:10000 view ((UK Power Networks use only).
		Notes.
29		Secondary distribution cables.
30		Primary and secondary sites.
		•

Guidance notes.


Important notice:

If you do not understand the NetMAP record that you are using, please contact the UK Power Networks Network Records team for guidance on **Tel: 08000 565866.**

- The position of apparatus shown on NetMAP is believed to be correct, but the original landmarks may have altered since the apparatus was installed.
- It must be assumed that there is at least one service to each property, lamp column, street sign etc.
- Third party cables are not usually shown.
- When viewed in black and white, the line-style indicates the voltage.
- All LV cables are 4 core and all HV cables are 3 core unless otherwise stated.
- All cables are copper unless otherwise stated.



Plan Provision Team and CableWatch Fore Hamlet Ipswich Suffolk IP3 8AA Tel: 08000 565866

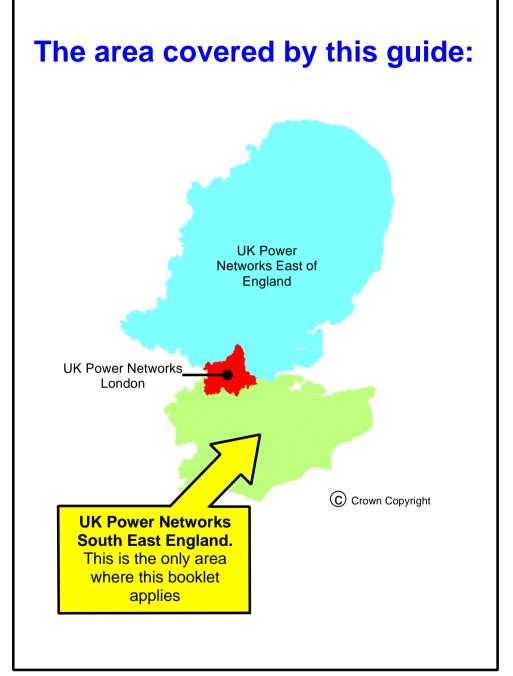

1:500 (& 1:1250) view

Scenery

NetMAP system	Description
	Secondary buildings and fence lines Building line Kerb line UK Power Networks / SPN licence boundary (not visible unless selected)

3

Scenery for UK Power Networks use only - boxed in red

Inset Network – Contact xxxx IDNO for further information

NetMAP system



(c

Area of inset network - not the asset of UK Power Networks

Description

(only visible to UK Power Networks and their immediate contractors)

Proposed Cross Rail route

(only visible to UK Power Networks and their immediate contractors)

High pressure pipelines in the general vicinity

(only visible to UK Power Networks and their immediate contractors)

Note: Pipelines are only viewable on NetMAP by UK Power Networks staff and their immediate contractors. Do not carry out any excavation without consent from the relevant agency - legally protected high pressure petroleum products pipeline route in the general vicinity - consult www.linewatch.co.uk for contacts and guidance. Pipeline contact numbers can also be found on the intranet —out of hours, contact our Control Centre.







Water - surface water

(only visible to UK Power Networks and their immediate contractors)

Water - Source Protection Zone 1 (only visible to UK Power Networks and their immediate contractors)

Water - Source Protection Zone 2 (only visible to UK Power Networks and their immediate contractors)

Water - Source Protection Zone 3 (only visible to UK Power Networks and their immediate contractors)

section continued on next page

Scenery for UK Power Netw	vorks use only - boxed in red
NetMAP system	Description
	Historical - Scheduled Monuments (only visible to UK Power Networks and their immediate contractors)
	Historical - Parks and Gardens (only visible to UK Power Networks and their immediate contractors)
	Historical - Areas of Archaeological Potential (AAP) (only visible to UK Power Networks and their Immediate contractors)
	Nature - Ramsar Wetlands of International Importance (only visible to UK Power Networks and their immediate contractors)
	Nature - Special Area of Conservation (SAC) (only visible to UK Power Networks and their immediate contractors)
	Nature - Special Protected Area (SPA) (only visible to UK Power Networks and their immediate contractors)
	Nature - Site of Special and Scientific Interest (SSSI) (only visible to UK Power Networks and their immediate contractors)
section continu	ued on next page

Scenery for UK Power Netw	orks use only - boxed in red
NetMAP system	Description
4	Nature - Local Nature Reserve (only visible to UK Power Networks and their immediate contractors)
	Nature - National Nature Reserve (only visible to UK Power Networks and their immediate contractors)
\sim	Nature - Area of Outstanding Natural Beauty (AONB) (only visible to UK Power Networks and their immediate contractors)
	Nature - National Park (only visible to UK Power Networks and their immediate contractors)
	Fluid filled cables - very high sensitivity (only visible to UK Power Networks and their immediate contractors)
	Fluid filled cables - high sensitivity (only visible to UK Power Networks and their immediate contractors)
	Fluid filled cables - medium sensitivity (only visible to UK Power Networks and their immediate contractors)
	Fluid filled cables - low sensitivity (only visible to UK Power Networks and their immediate contractors)

NetMAP system	Description
RECOGNISHED BY DESIGNATURE OF DESIGNATURE OF DESIGNATURE	275-400kV National Grid rou
	132kV cable route
	33kV cable route
Approximate routes o	nly — see seperate record

	11kV underground cable 11kV overhead line
	6.6kV underground cable
	6.6kV overhead line
	<6.6kV underground cable
2555002 155 535 531 MIN	<6.6kV overhead line
	LV underground cable
•	LV overhead line
Pilot	Pìlot cable
2c SU pl	LV street lighting (pl)
•	Service overhead line
	Service underground
	Logical service connection

Secondary distribution cable terminology (1:500 view)			
	HV underground		
sta (no text) XLPE bcs scs ua c/c Poly BOTES of 33 kV design ax cx	PILCSTA (paper insulated lead covered steel tape armour) PILCSWA (paper insulated lead covered steel wire armour) XLPE (cross linked polyethylene) insulation CAS (corrugated aluminium sheath) belted construction CAS (corrugated aluminium sheath) with screened cores PILC (paper insulated lead covered) unarmoured Concentric cores Poly (polyethylene) insulation BOTES — Board of Trade earth screen Oil filled Constructed to 33 kV specification Triplex with aluminium conductor Triplex with copper conductor		
	HV overhead		
(no text) pvc cat +ew ccc	Bare open wire Open wire PVC covered ABC (aerial bundled or bunched conductor) with supporting strain wire Open wire with extra earth conductor Compact covered conductor		
	Overhead line materials		
ccs ccs ccs ccs	Steel cored aluminium Cadmium copper Steel Simalec Copper covered steel Compactal		
	section continued on next page		

Secondary distribution cable terminology continued (1:500 view)
LV underground mains and services


W We H He ua (no text) XLPE DISTRI c/c s/c	Waveform Waveform with seperate earth wire Hybrid — copper neutral with aluminium phase conductor Hybrid with seperate earth wire PILC (paper insulated lead covered) unarmoured PILC (paper insulated lead covered) with/without armour XLPE (cross linked polyethylene) insulation PISTA (paper insulated steel tape armour) 4c SAC (solid aluminium core) with lead covered neutral Concentric cores Split concentric with seperated neutral and earth wires
CONSAC vb Capothene tby swa sac Solidal LSF Trough	Paper insulated aluminium sheathed 3 core with solid aluminium cores Vulcanised bitumen/rubber insulation Capothene core insulation Tape braid and yarn PILSWA (paper insulated lead steel wire armour) PILSTA (paper insulated steel tape armour) solid aluminium core 4 sector SAC with solid aluminium cores Low smoke and fume (orange cable) Cable laid in filled trough

LV overhead mains and services


(no text)	Bare open wire
ABC	Aerial bundled (or bunched) conductor
cat	ABC (aerial bundled or bunched conductor) with supporting strain wire
pvc	PVC covered open wire
c/c	Concentric cores
Н	Hybrid — copper neutral with aluminium phase conductor
ue	Under eaves — hessian covered lead cable
vir	Vulcanised India rubber insulation
	section continued on next page

Secondary distribution cable terminology continued (1:500 view)

	Various annotation
.1	Cable size (sq. inches)
185	Cable size (sq. millimetres)
а	Aluminium
ITC	Instrument traced cable or ITC - cable traced electronically using Cable Avoidance Tool (CAT) or similar

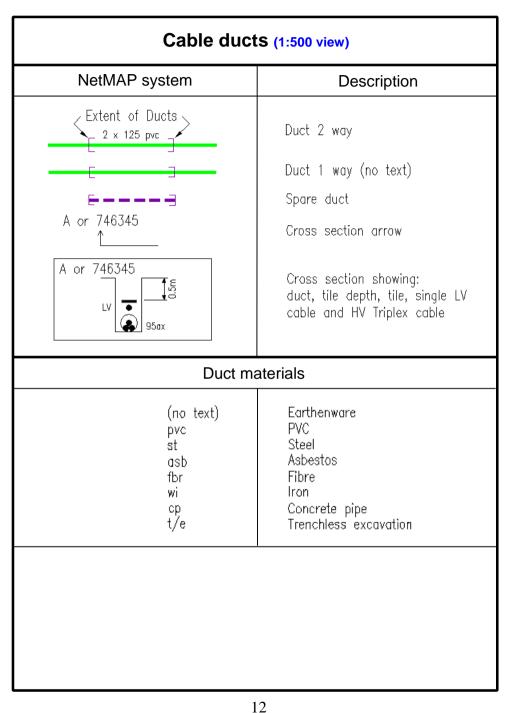

NetMAP system Section pole Pole number (unique) Single leg H pole The pole The pole The pole The pole The pole The pole The pole The pole The pole The pole The pole The pole The pole The pole support (stay) Tower 33kV to 400kV	Poles	Poles (1:500 view)		
Pole number (unique) Single leg H pole 3 member 4 member Strut Pole support (stay) Flying stay	NetMAP system	Description		
Strut Pole support (stay) Flying stay	9 99 999	Pole number (unique) Single leg		
Strut Pole support (stay) Flying stay	1			
Pole support (stay) Flying stay				
	₩			

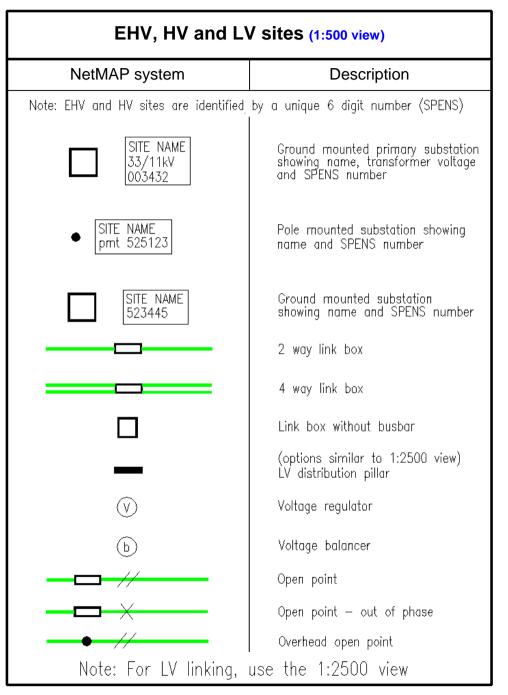

NetMAP system	Description
	Straight (same for HV)
<i>′</i>	Pot end (same for HV)
	Branch (same for HV)
	Sleeve repair
•	Capped end
	Service to LV main
•	Under eaves service
.1 .15 a R - R Y - B B - Y	Jointing phase drawing

Street furniture (1:500 view)		
NetMAP system	Description	
-0	Pole mounted street light Street light	
0	Zebra crossing Road sign Bollard Pelican crossing	
0	Traffic controller Advertising sign Amplifier station	
	Control cubicle <u>Text displayed/description</u>	
□ ^{TBS}	Pay and display Bus shelter TBS Kiosk Water meter PL pillar TCB	
	Unknown	

Miscellaneous (1:500 view)	
NetMAP system	Description
[-] [_] -**-	Underground chamber or draw pit Earth conductor
F	Earth pin
H 1.0 +	Height marker
D 1.0 🕁	Depth marker
×	Supply point
CAUTION Missing Information	Missing data in or near this location
Contaminated Land refer to SHE 01 016	Contaminated land reference

	tivity (1:500 view)
NetMAP system	Description
\oplus	Edge node
+	Node
•	Connector
	Pole termination
	(nothing visible unless selected
Edge nodes, nodes, connectors and pole termination joints may not appear on screen unless turned on and selected.	

NR SU Size unknown AB (M) VO5 Year LV linking verified MS MP pmt pmt Ple mounted transformer pl TBS TCB No record Size unknown Abandoned PME available YMS Abandoned PME available PME available PME available PME available PME available Phe	Abbreviations (1:500 view)	
SU Size unknown AB Abandoned (M) PME available VO5 Year LV linking verified MS Milestone MP Marker post pmt Pole mounted transformer pl Public lighting TBS Temporary builder's supply TCB Telephone call box	NetMAP system	Description
T Instrument traced (same as CET)	SU AB (M) VO5 MS MP pmt pl TBS TCB CET IT CAT +sl +sw 2c PESL Added Excluded IIP VSxxxx	Size unknown Abandoned PME available Year LV linking verified Milestone Marker post Pole mounted transformer Public lighting Temporary builder's supply Telephone call box Cable electronically traced Instrument traced (same as CET) Cable avoidance tool (same as CET) Street lighting Switch wire 2 core Public Electricity Supply License Supplied by SPN Not supplied by SPN Assumed open point Vacant site

Cable phasing (1:500 view)		
Old core colours Neutral Red Yellow Blue	Shown on map Neutral Neutral R L1 Y L2 B L3 Note:— Scott is a different phasing	<u>New core colours</u> Blue Brown Black Grey g system

Operational status colours (1:500 view) PROPOSAL — Symbols and cables appear in ORANGE OUT OF SERVICE — Cable and joints appear in BLACK ABANDONED — Cables and joints appear in GREY

21


1:2500 view - for UK Power **Networks use only - boxed red**


Notes

No underground HV cables are shown on the 1:2500 view

- Poles and joint details are similar to the 1:500 view
 For cable/line information refer to the 1:500 view

Primary distribution line route (1:2500 view)	
NetMAP system	Description
	275—400kV National Grid route 132kV cable route 33kV cable route

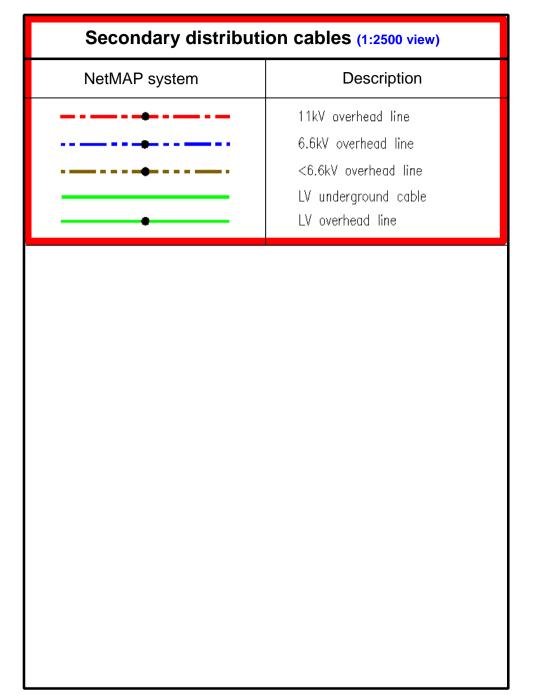

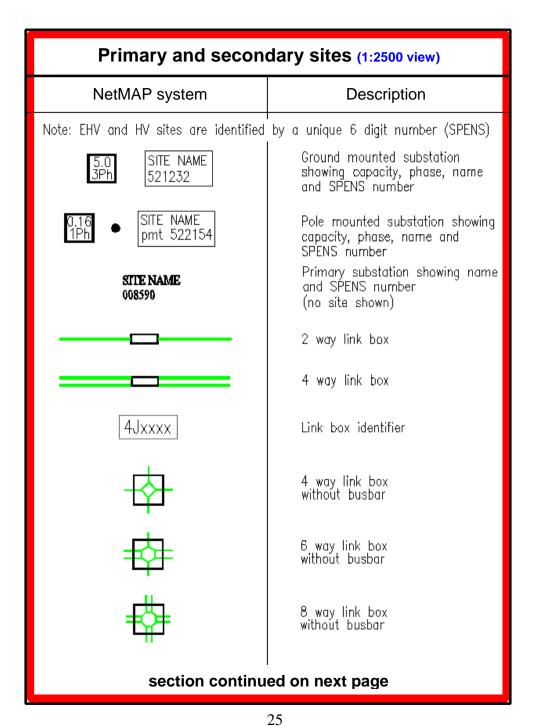

Primary and secondary sites continued (1:2500 view)	
NetMAP system	Description
	LV distribution pillar
V	Voltage regulator
b	Voltage balancer
	Open point
	Open point — out of phase
E	Earth pin

Switch types (1:2500 view)		
NetMAP system	Description	
ABSD A/R A/S FUSE S/D PF ASL PMR PMS GVR	Air brake switch disconnector Auto recloser Sectionaliser Fuse Surge diverter Pathfinder Automatic sectionalising links Pole mounted recloser Pole mounted sectionaliser Gas vacuum recloser	

1:10000 view - for UK Power Networks use only - boxed red

Notes

- 1. No EHV cables/overhead lines shown on 1:10000 view.
- 2. For congested areas print at 1:5000.
- 3. HV site used instead of branch joint on 1:10000 for connectivity purposes. The site is not displayed until it is selected.

Secondary distribution cables (1:10000 view)	
NetMAP system	Description
	11kV underground cable 6.6kV underground cable <6.6kV underground cable 11kV overhead line 6.6kV overhead line <6.6kV overhead line

Primary and secondary sites (1:10000 view)	
NetMAP system	Description
Note: EHV and HV sites are identified	l by a unique 6 digit number (SPENS)
SITE NAME 008590	Primary substation showing name and SPENS number
SITE NAME 521234 ■	11kV ground mounted substation showing name and SPENS number
SITE NAME 524514	6.6kV ground mounted substation showing name and SPENS number
SITE NAME 523634 □	<6.6kV ground mounted substation showing name and SPENS number
SITE NAME pmt 527522	11kV pole mounted substation showing name and SPENS number
SITE NAME pmt 525743	6.6kV pole mounted substation showing name and SPENS number
pmt 525743 SITE NAME pmt 526543	<6.6kV pole mounted substation showing name and SPENS number
SITE NAME \bigcirc 527238	Pole mounted switching substation showing name and SPENS number



Registered Office: Newington House 237 Southwark Bridge Road

London SE1 6NP

Registered in England and Wales No: 3870728

Company: UK Power Networks (Operations) Limited

Our Ref: 33336857 Your Ref: DA/24/00510/FUL

Wednesday, 08 May 2024

Dartford Borough Council Civic Centre Dartford KEN DA1 1DR

Thank you for contacting us regarding UK Power Networks equipment at the above site. I have enclosed a copy of our records which show the electrical lines and/or electrical plant. I hope you find the information useful.

I have also enclosed a fact sheet which contains important information regarding the use of our plans and working around our equipment. Safety around our equipment is our number one priority so please ensure you have completed all workplace risk assessments before you begin any works.

Should your excavation affect our Extra High Voltage equipment (6.6 KV, 22 KV, 33 KV or 132 KV), please contact us to obtain a copy of the primary route drawings and associated cross sections.

If you have any further queries do not hesitate to contact us.

Plan Provision 0800 056 5866









Registered Office: Newington House 237 Southwark Bridge Road London SE1 6NP

Registered in England and Wales No: 3870728

Company: UK Power Networks (Operations)

This information is made available to you on the terms set out below. If you do not accept the terms of use set out in this fact sheet please do not use the plans and return them to UK Power Networks.

- 1. UK Power Networks does not warrant that the information provided to you is correct. You rely upon it at your own risk.
- 2. UK Power Networks does not exclude or limit its liability if it causes the death of any person or causes personal injury to a person where such death or personal injury is caused by its negligence.
- 3. Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort (including negligence), for breach of statutory duty or otherwise how for any loss, damage, costs, claims, demands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use) or any special or consequential loss or damage whatsoever.
- 4. The information about UK Power Networks electrical plant and/or electric lines provided to you belongs to and remains the property of UK Power Networks. You must not alter it in any respect.
- 5. The information provided to you about the electrical plant and/or electric lines depicted on the plans may NOT be a complete record of such apparatus belonging to UK Power Networks. The information provided relates to electric lines and/or electrical plant belonging to UK Power Networks that it believes to be present but the plans are not definitive: other electric lines and/or electrical plant may be present and that may or may not belong to UK Power Networks.
- 6. Other apparatus not belonging to UK Power Networks is not shown on the plan. It is your responsibility to make your own enquiries elsewhere to discover whether apparatus belonging to others is present. It would be prudent to assume that other apparatus is present.
- 7. You are responsible for ensuring that the information made available to you is passed to those acting on your behalf and that all such persons are made aware of the contents of this letter.
- 8. Because the information provided to you may not be accurate, you are recommended to ascertain the presence of UK Power Networks electric lines and/or electrical plant by the digging of trial holes. Trial holes should be dug by hand only.

Excavations must be carried out in line with the Health and Safety Executive guidance document HSG 47. We will not undertake this work. A copy of HSG 47 can be obtained from the Health and Safety Executives website.

All electric lines discovered must be considered LIVE and DANGEROUS at all times and must not be cut, resited, suspended, bent or interfered with unless specially authorised by UK Power Networks.

The electric line and electrical plant belonging to UK Power Networks remains so even when made dead and abandoned and any such electric line and/or electrical plant exposed shall be reported to UK Power Networks.

Where your works are likely to affect our electric lines and/or electrical plant an estimate of the price of any protective /diversionary works can be prepared by UK Power Networks Branch at Metropolitan House, Darkes Lane, Potters Bar, Herts., EN6 1AG, telephone no. 0845 2340040









Registered Office: Newington House 237 Southwark Bridge Road London SE1 6NP

Registered in England and Wales No: 3870728

Company: UK Power Networks (Operations)

9 Any work near to any overhead electricity lines must be carried out by you in accordance with the Health and Safety Executive guidance document GS6 and the Electricity at Work Regulations.

The GS6 Recommendations may be purchased from HSE Books or downloaded from the Energy Networks Association's website.

If given a reasonable period of prior notice UK Power Networks will attend on site without charge to advise how and where "goal posts" should be erected. If you wish to use this service, in the first instance please telephone: 0845 6014516 between 08:30 and 17:00 Monday to Friday.

- 10. You are responsible for the security of the information provided to you. It must not be given, sold or made available upon payment of a fee to a third party.
- 11. If in carrying out work on land in, on, under or over which is installed an electric line and/or electrical plant that belongs to UK Power Networks you and/or anyone working on your behalf damages (however slightly) that apparatus you must inform immediately UK Power Networks by our emergency 24 hour three digit telephone number 105 providing;


your name, address and telephone number; the date, time and place at which such damage was caused; a description of the electric line and/or electrical plant to which damage was caused; the name of the person whom it appears to you is responsible for that damage; the nature of the damage.

12. The expression "UK Power Networks" includes UK Power Networks (EPN) plc, UK Power Networks (LPN) plc, UK Power Networks (SEPN) plc, UK Power Networks and any of their successors and predecessors in title.







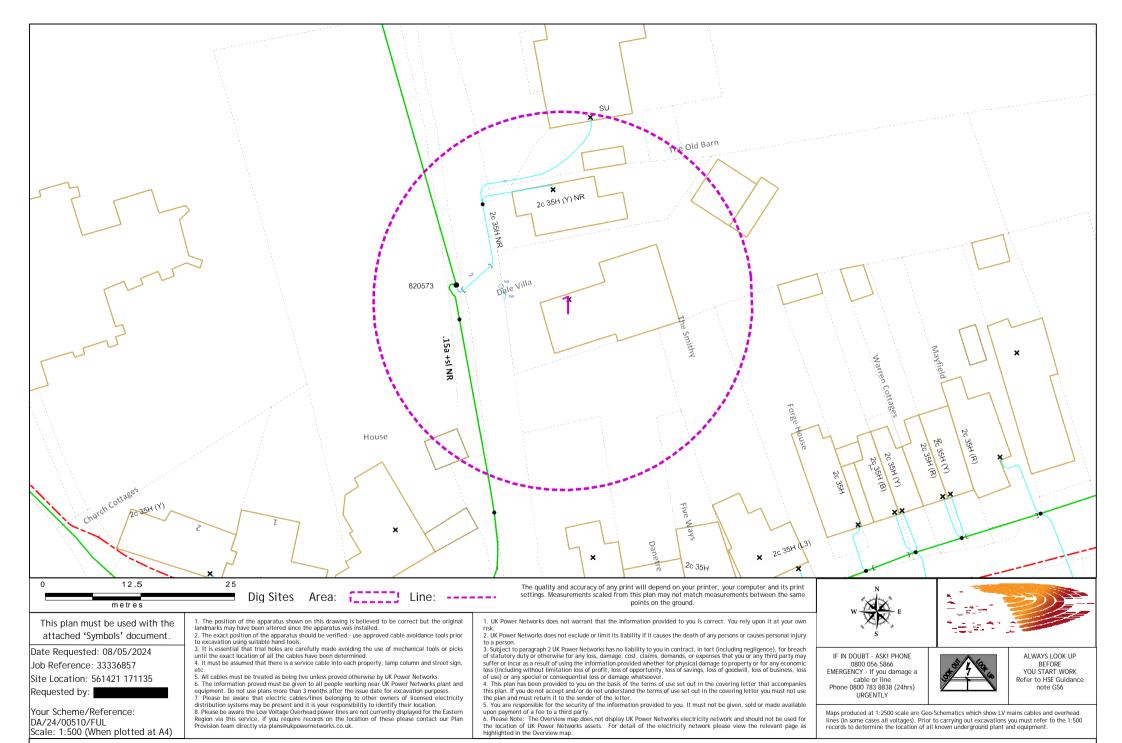

Reproduced by permission of Ordnance Survey on behalf of HMSO. © Crown copyright and database rights 2023. All rights reserved. Ordnance Survey Licence numbers 100019626, 100019826 and 100019450. Data has been added to the Ordnance Survey base map: all proprietary rights in such additional data are and shall remain the exclusive property of © London Power Networks pic or South Eastern Power Networks pic or South Eastern Power Networks pic or South Eastern Power Networks pic ach being a distribution licensee under section 6(1)(c) of the Electricity Act 1989 for the relevant distribution services area as that term is defined in such licensee's distribution licence. All rights in such data reserved. Plans generated by DigSAFE Pro* software provided by LinesearchbeforeUgig.





UK Power Networks Feedback Tool

Please help UK Power Networks improve the accuracy of their network records and help make it safer for all those working around them in future.

All you need to do is:

- 1. Use your phone camera to scan the QR code:
- 2. Provide feedback on what you have found on site (good or bad)
- 3. Upload a photo if needed



Thank you for making the area a safer place to dig.

UK Power Networks, working with LSBUD